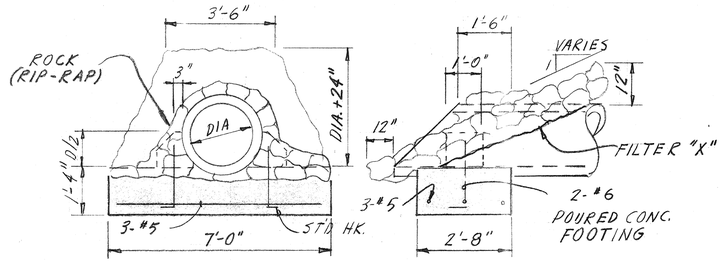

TYPICAL ENDWALL

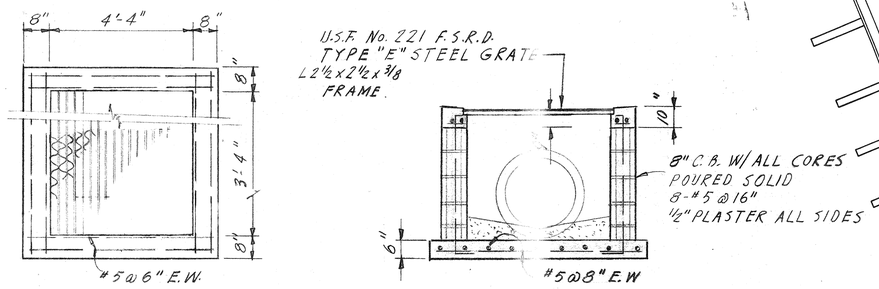

PLAN

SECTION

TYPICAL DROP INLET

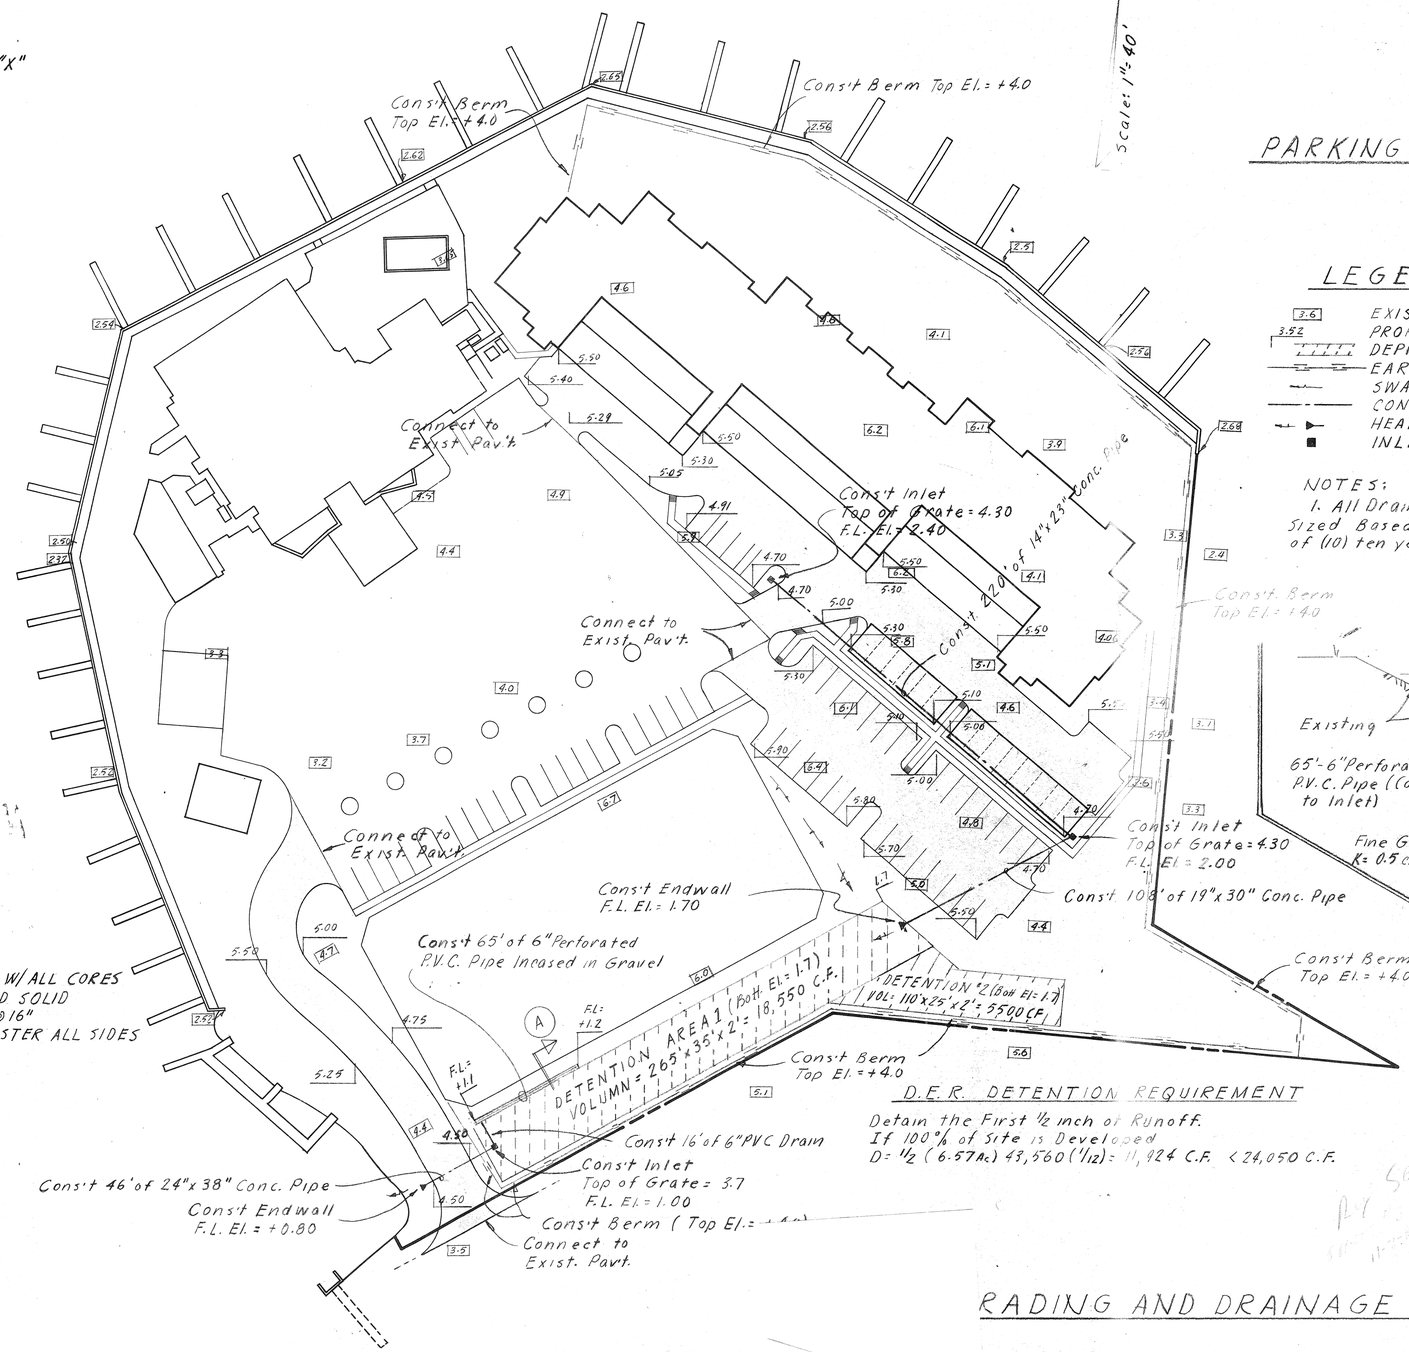

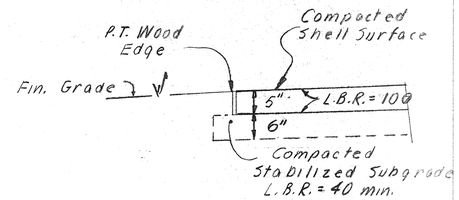

PARKING LOT SECTION

LEGEND

- 3.6 EXISTING ELEVATIONS
- 3.52 PROPOSED ELEVATIONS
- DEPRESSED DETENTION AREA
- EARTH BERM
- SWALE
- CONCRETE PIPE CULVERT
- HEADWALL
- INLET

NOTES:
1. All Drainage Structures are Sized Based on a Design Storm of (10) ten year intervals.

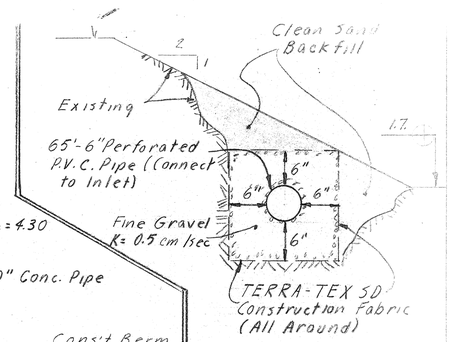

SECTION (A)

D.E.R. DETENTION REQUIREMENT

Detain the First ½ inch of Runoff.
If 100% of Site is Developed
D = ½ (6.57 Ac.) 43,560 (1/12) = 11,924 C.F. < 24,050 C.F.

RADING AND DRAINAGE PLAN

BUCCANEER INN

OVERLAYS
COMPOSITE
H. HARBOUR VILLAS
BUCCANEER INN HOTEL
OCT 24 1980
TOWN OF FORT MYERS BEACH