



WATER DISTRIBUTION

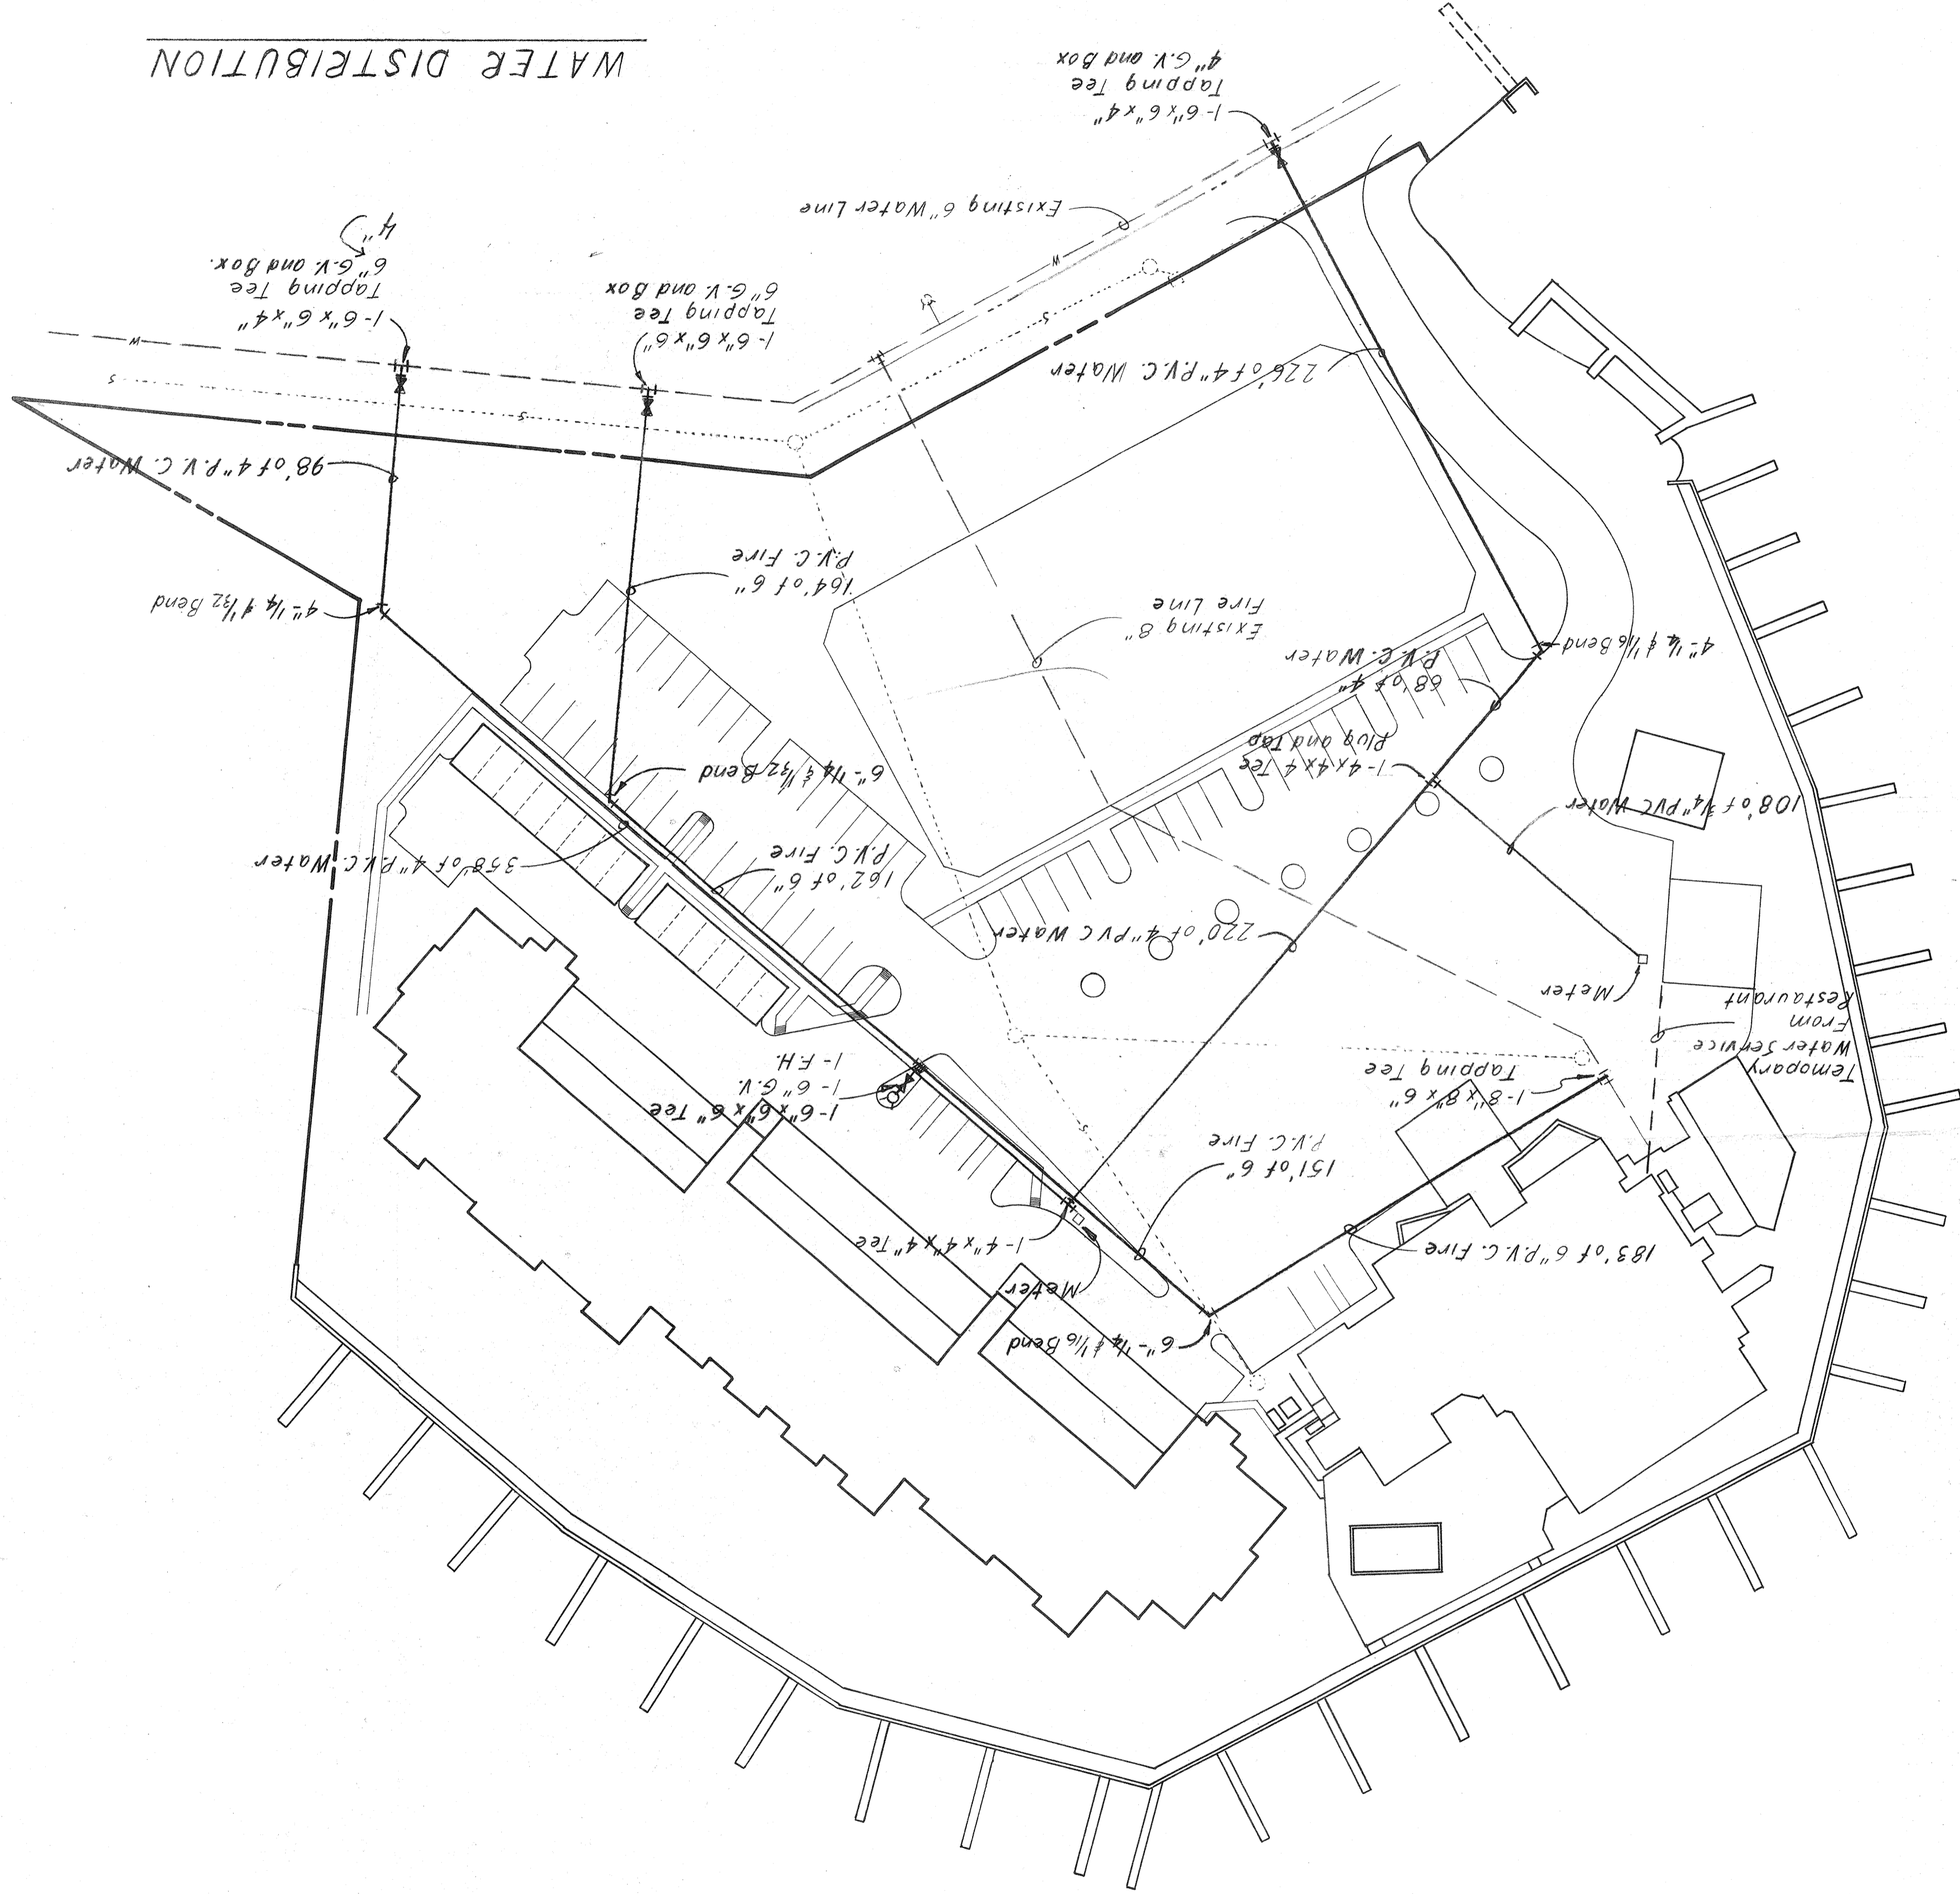

Scale: 1"=40'

NOTES:
 1. Provide a minimum of 36" of Cover on all Water Lines
 2. Pipe shall be AWWA C-900 Underwriter Approved
 3. DR 17 or 18, Blue in Color and Buried With Detection
 Tape.

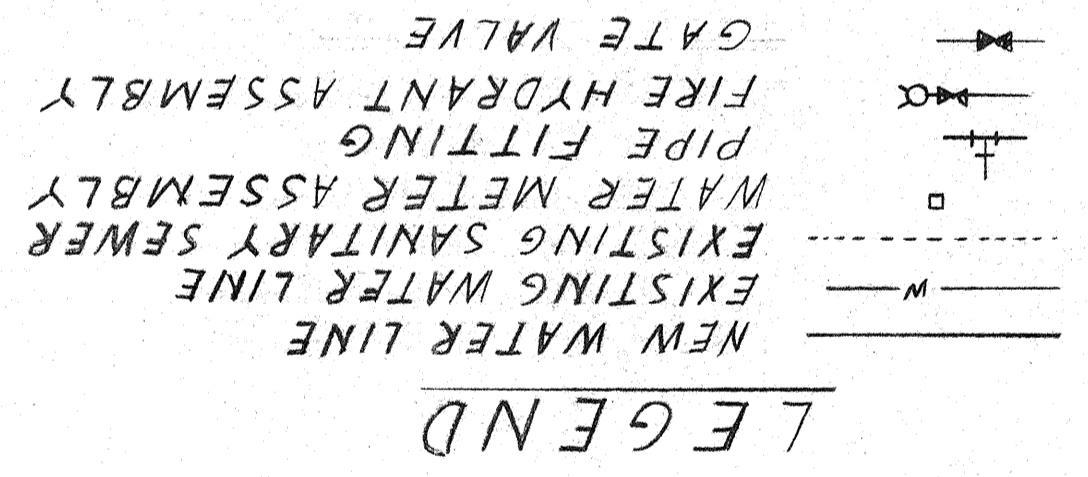

HARBOUR VILLAS
 BUCCANIER INN HOTEL