

GULF OF MEXICO DRIVE

F.M.

EXISTING

10"

EXISTING


10"

EXISTING


10"

EXISTING

10"

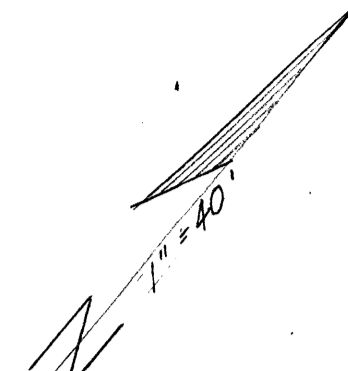

EXISTING STRUCTURES (APPROX.)

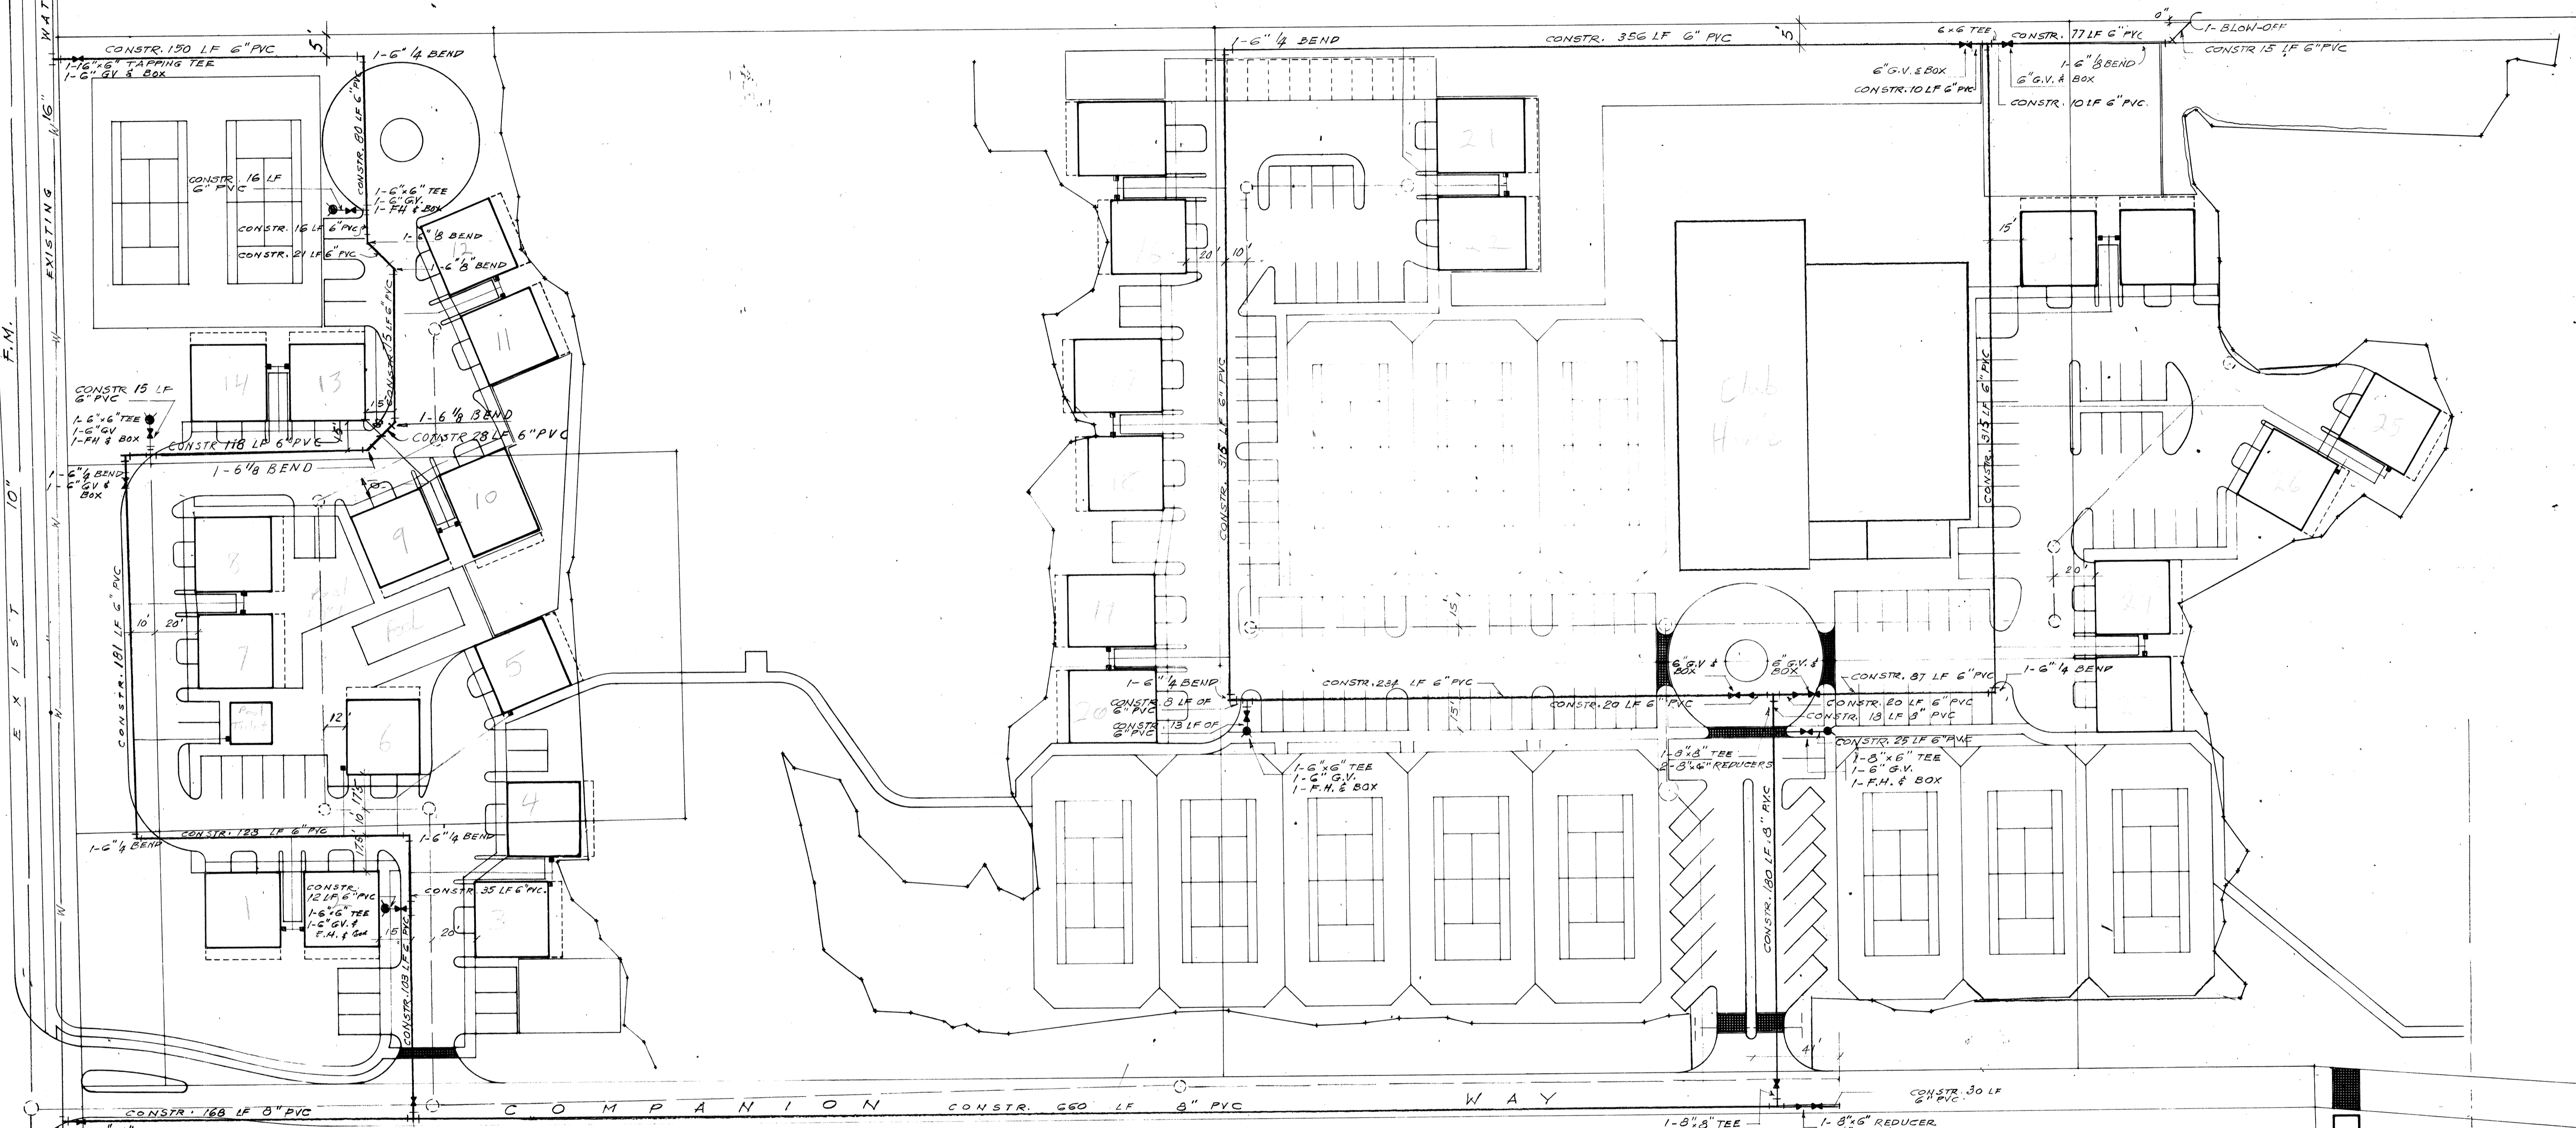

- LEGEND
- ┆ TEE
 - ┆ BEND
 - ┆ BEND
 - ▼ REDUCER
 - ⊗ GATE VALVE
 - FIRE HYDRANT
 - SANITARY SENER & MANHOLE
 - LIFT STATION
 - WATER METER

NOTE:
All water piping to Equal SDR 17 or 18,
C 900-75, Blue in Color, Minimum 36" Cover.

FIRE WATER LINE PLAN

CEDARS EAST

20 NOV 85
20 OCT 85
10.2.85

C16

HUNT BUILDING CORPORATION EDWARD J. SEIBERT AIA ARCHITECT & PLANNER PA A. L. CONYERS CONSULTING ENGINEER PE