



TYPICAL HYDRANT DETAIL
NO SCALE

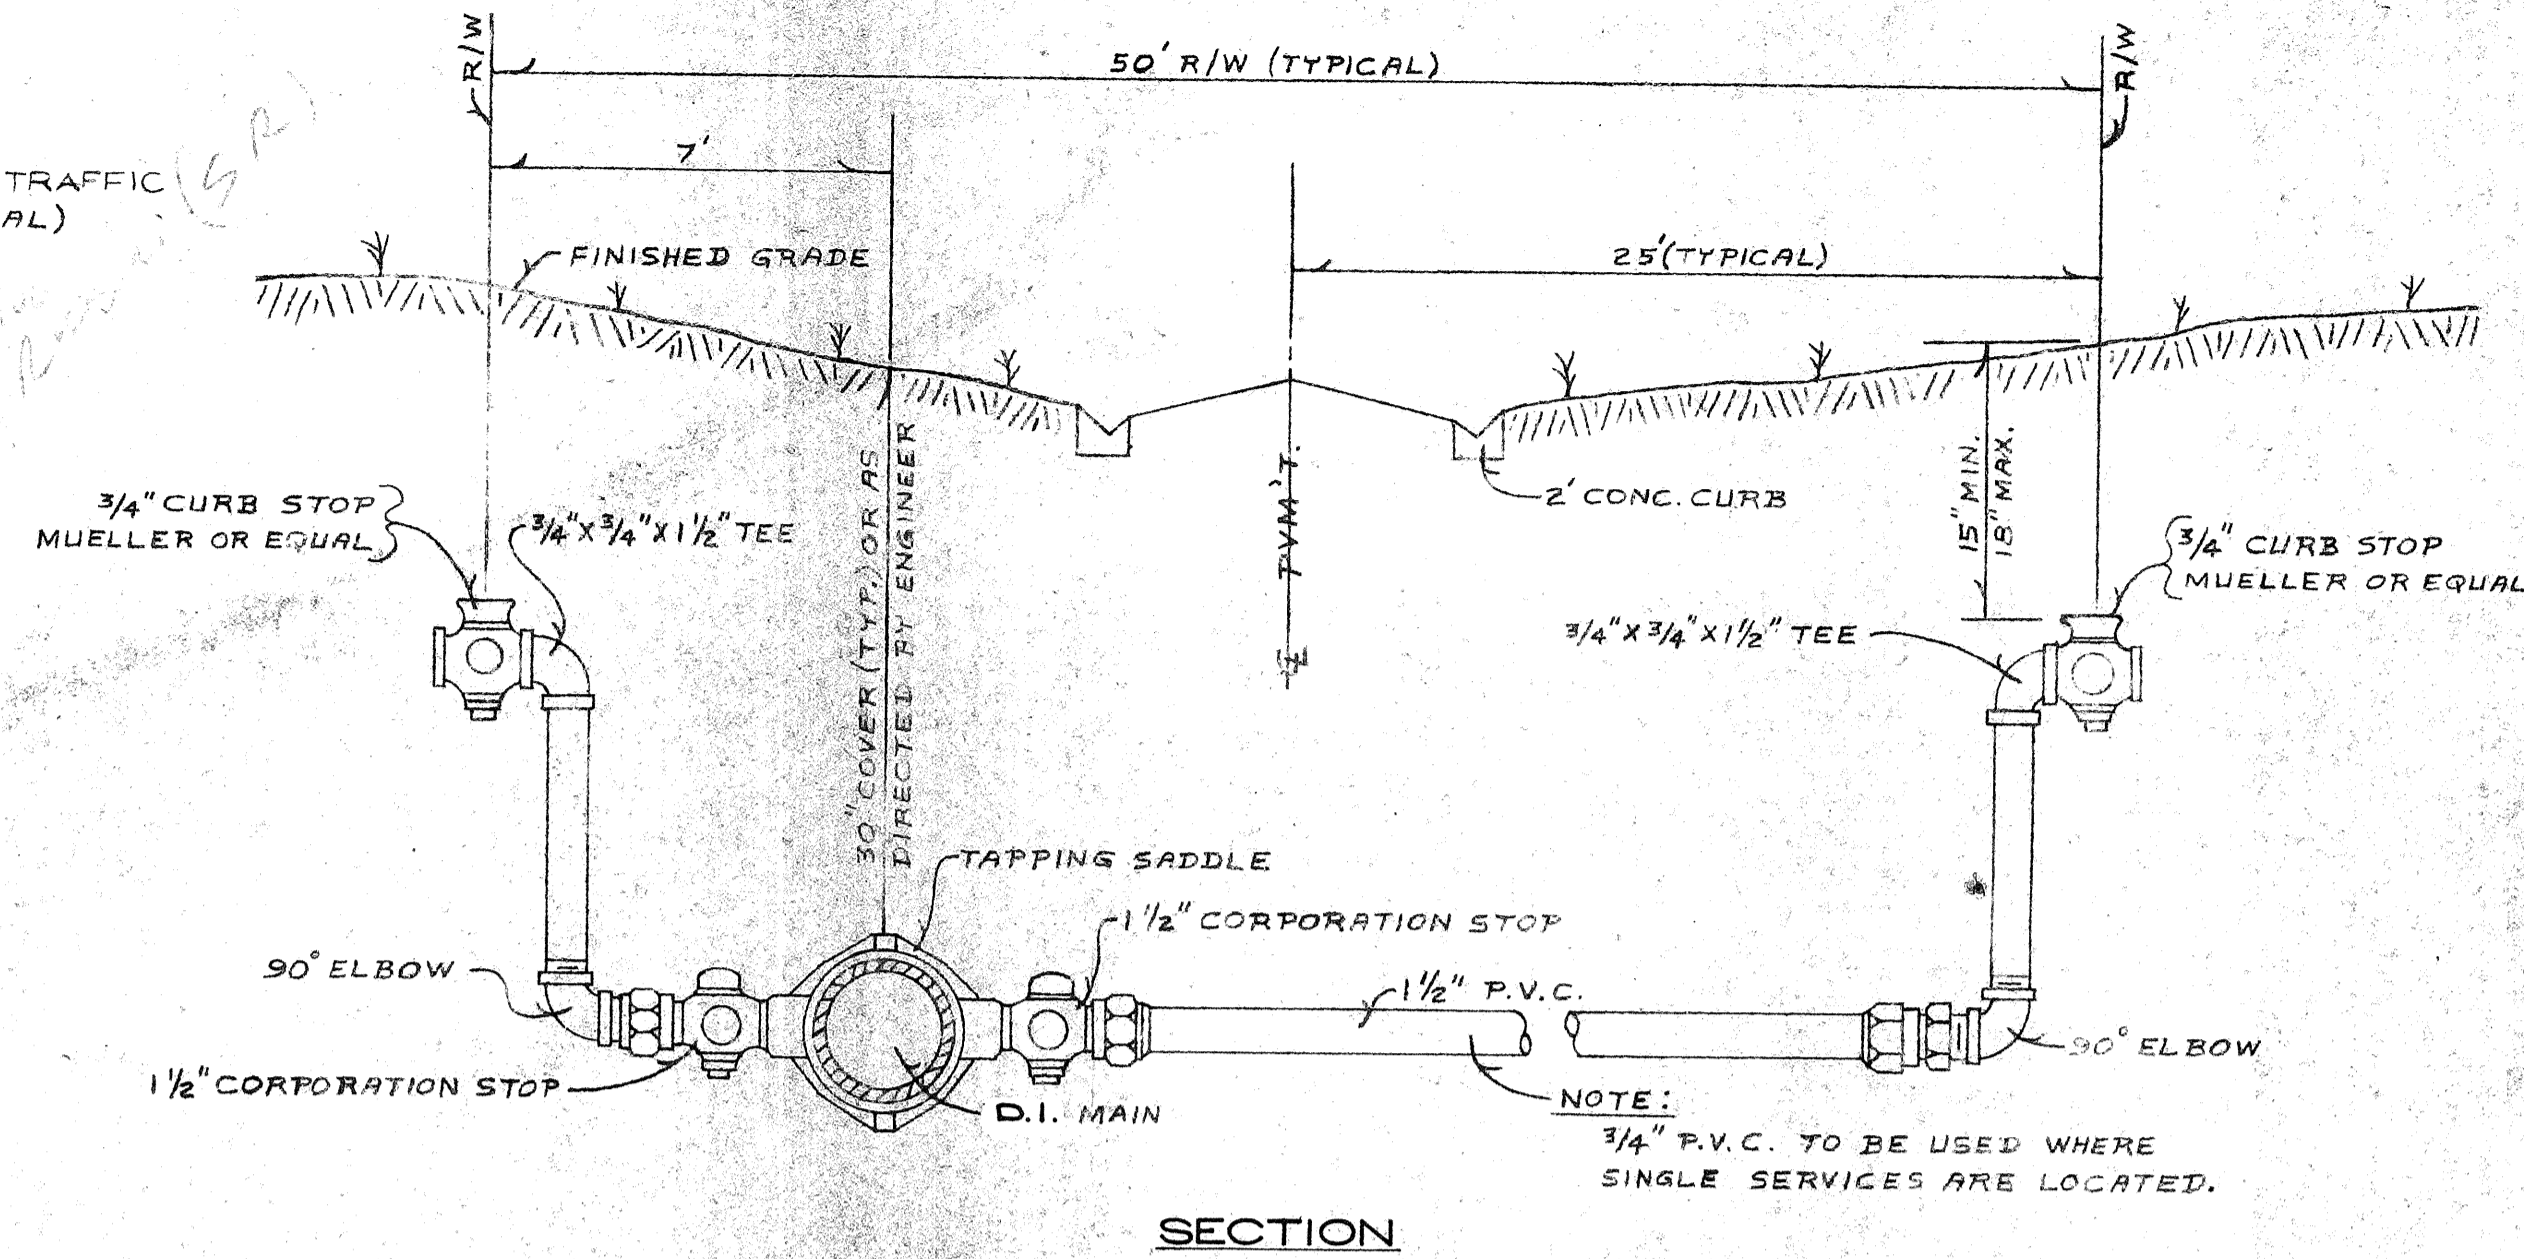


SECTION

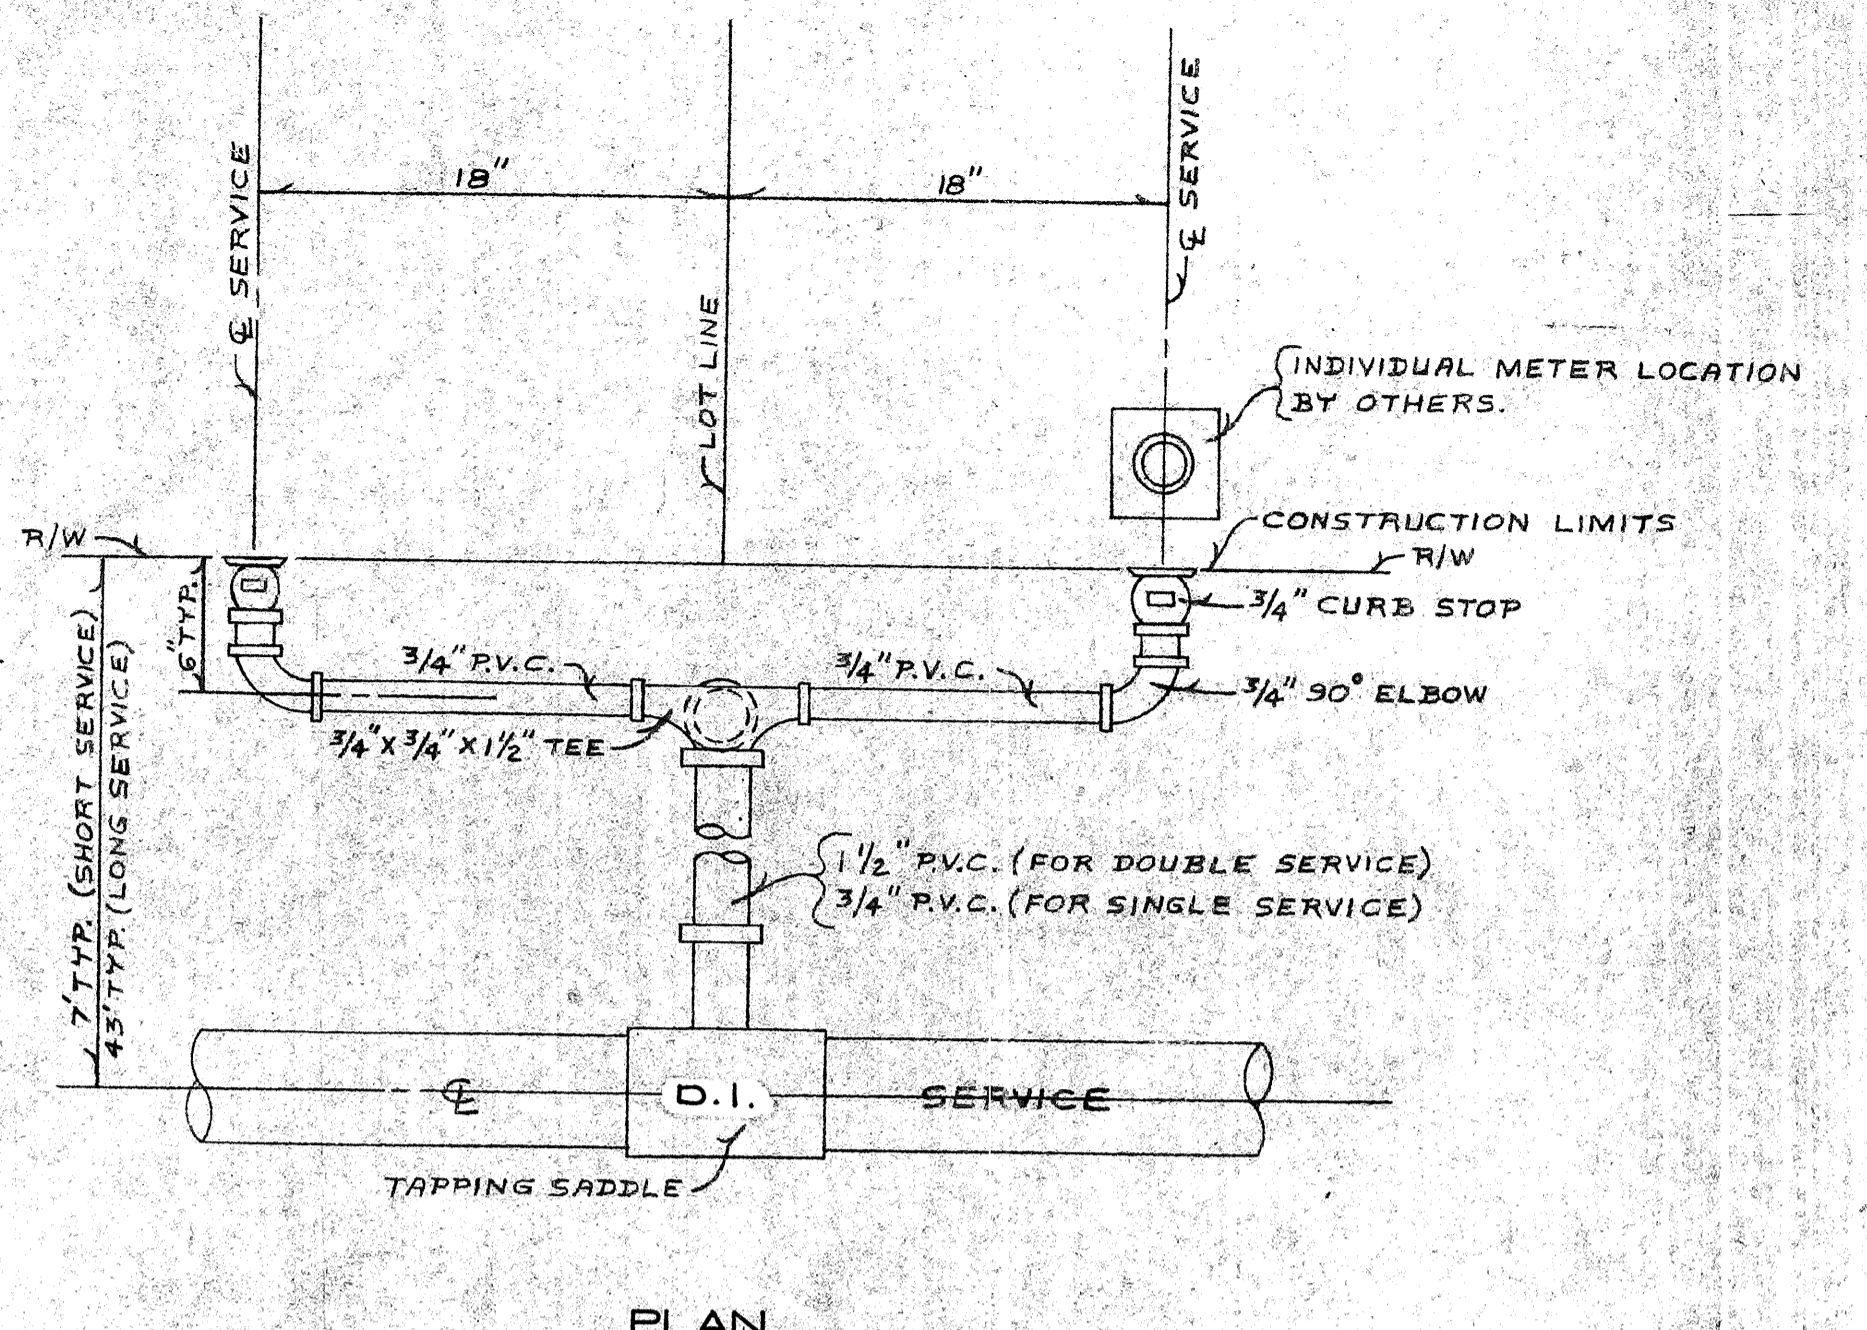


PLAN

TYPICAL WATER SERVICE CONNECTION
NO SCALE

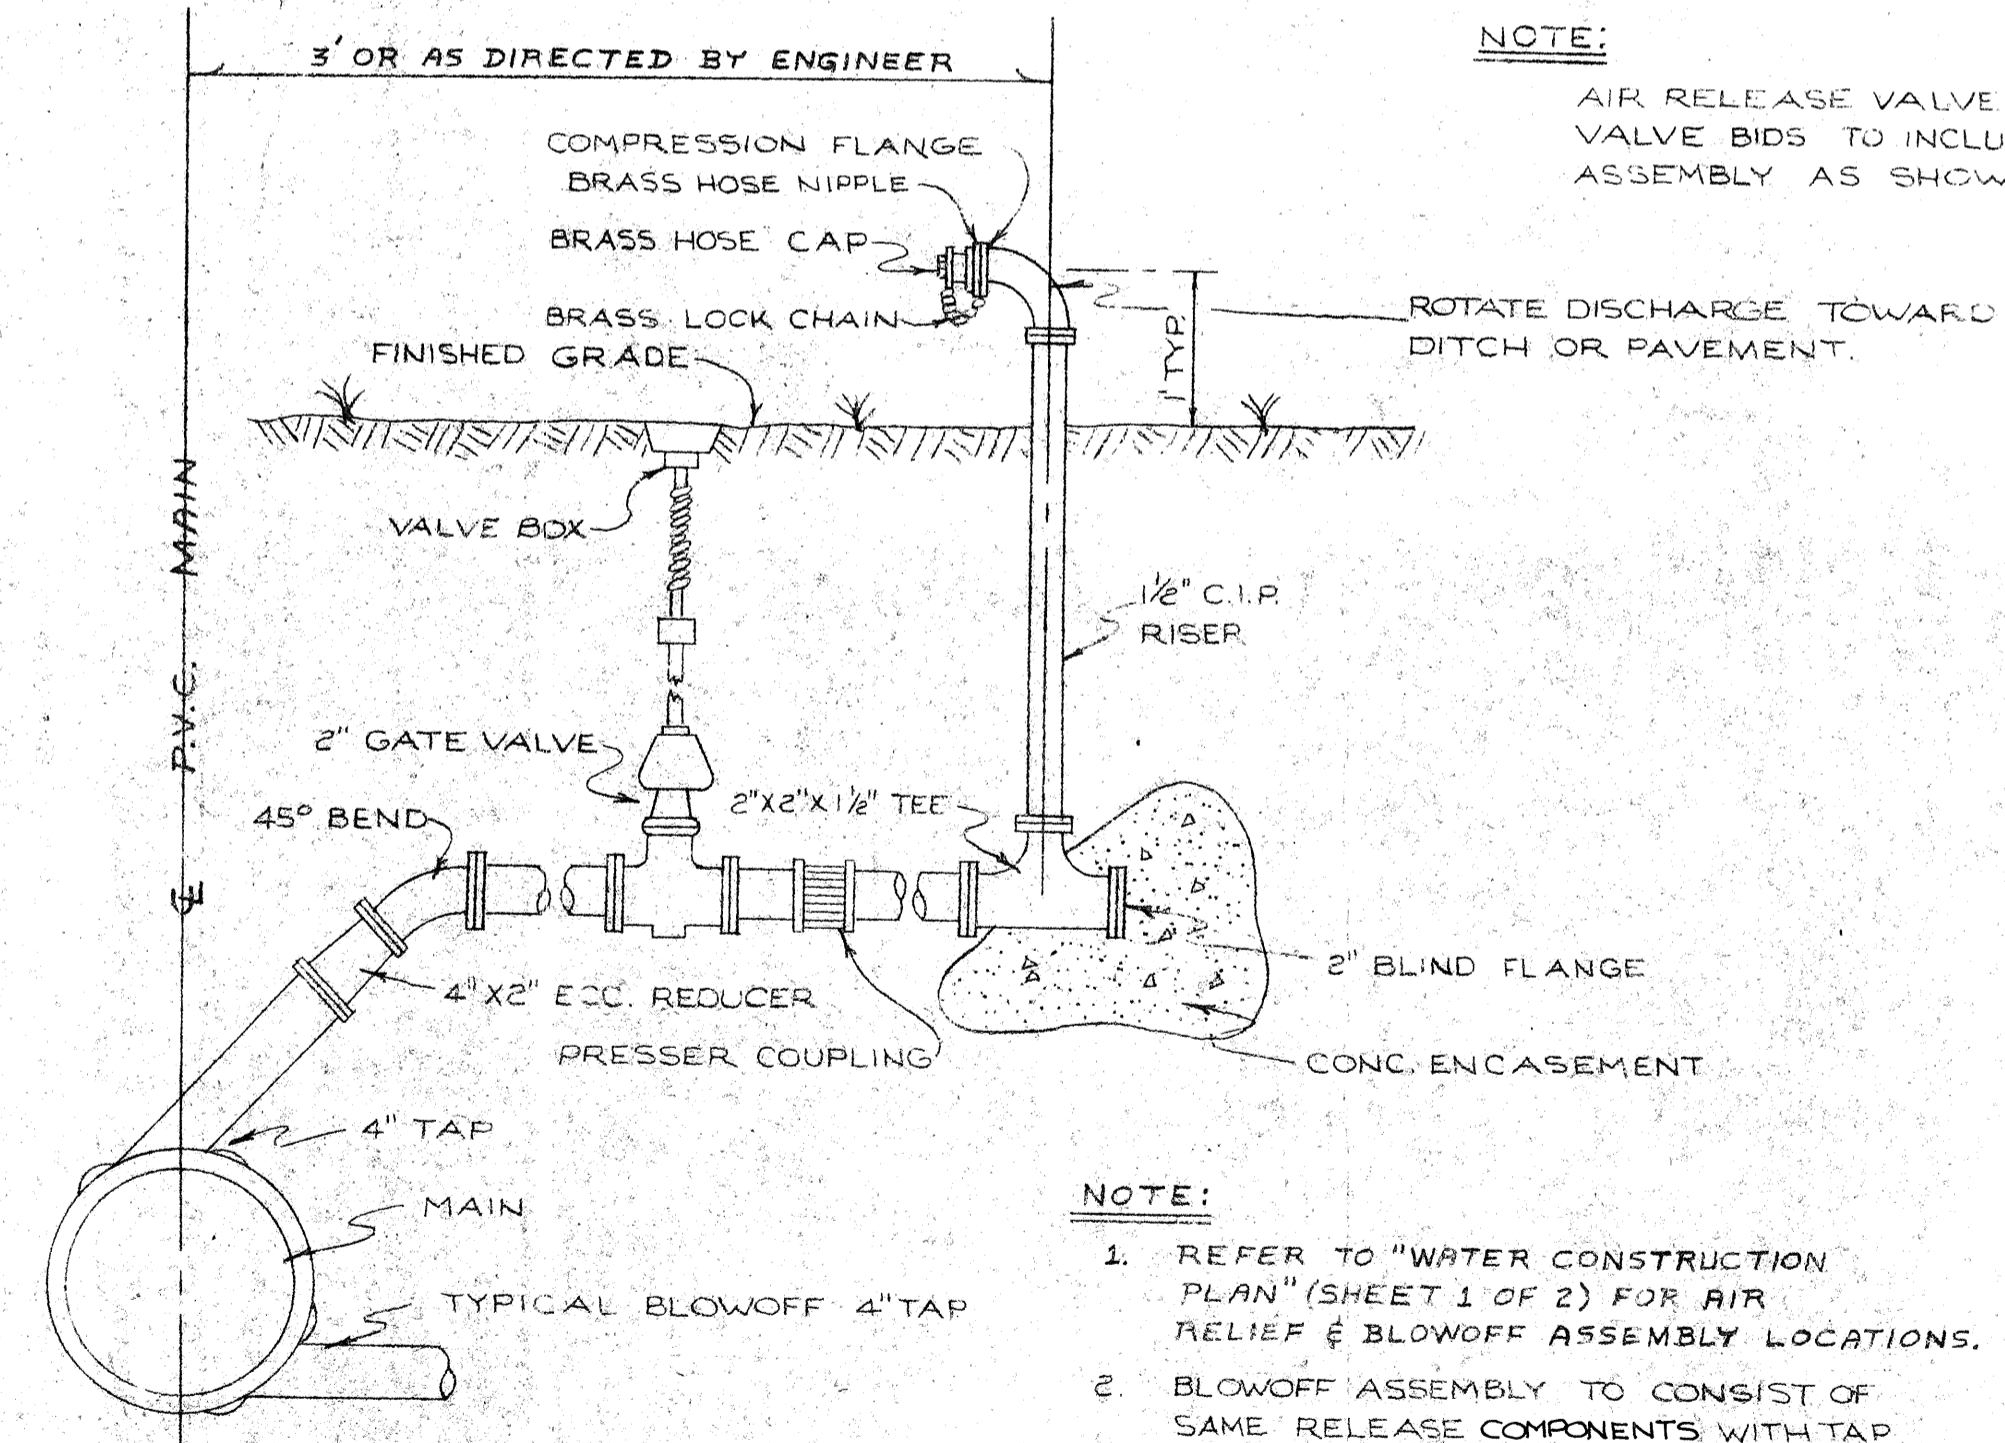

- NOTE:
1. REFER TO "WATER CONSTRUCTION PLAN" (SHEET 1 OF 2) FOR AIR RELIEF & BLOWOFF ASSEMBLY LOCATIONS.
 2. BLOWOFF ASSEMBLY TO CONSIST OF SAME RELEASE COMPONENTS WITH TAP AT BOTTOM OF MAIN AS SHOWN, ALSO REFER TO CONSTRUCTION PLAN PROFILE FOR LOCATION.

AIR RELEASE VALVE ASSEMBLY
NO SCALE

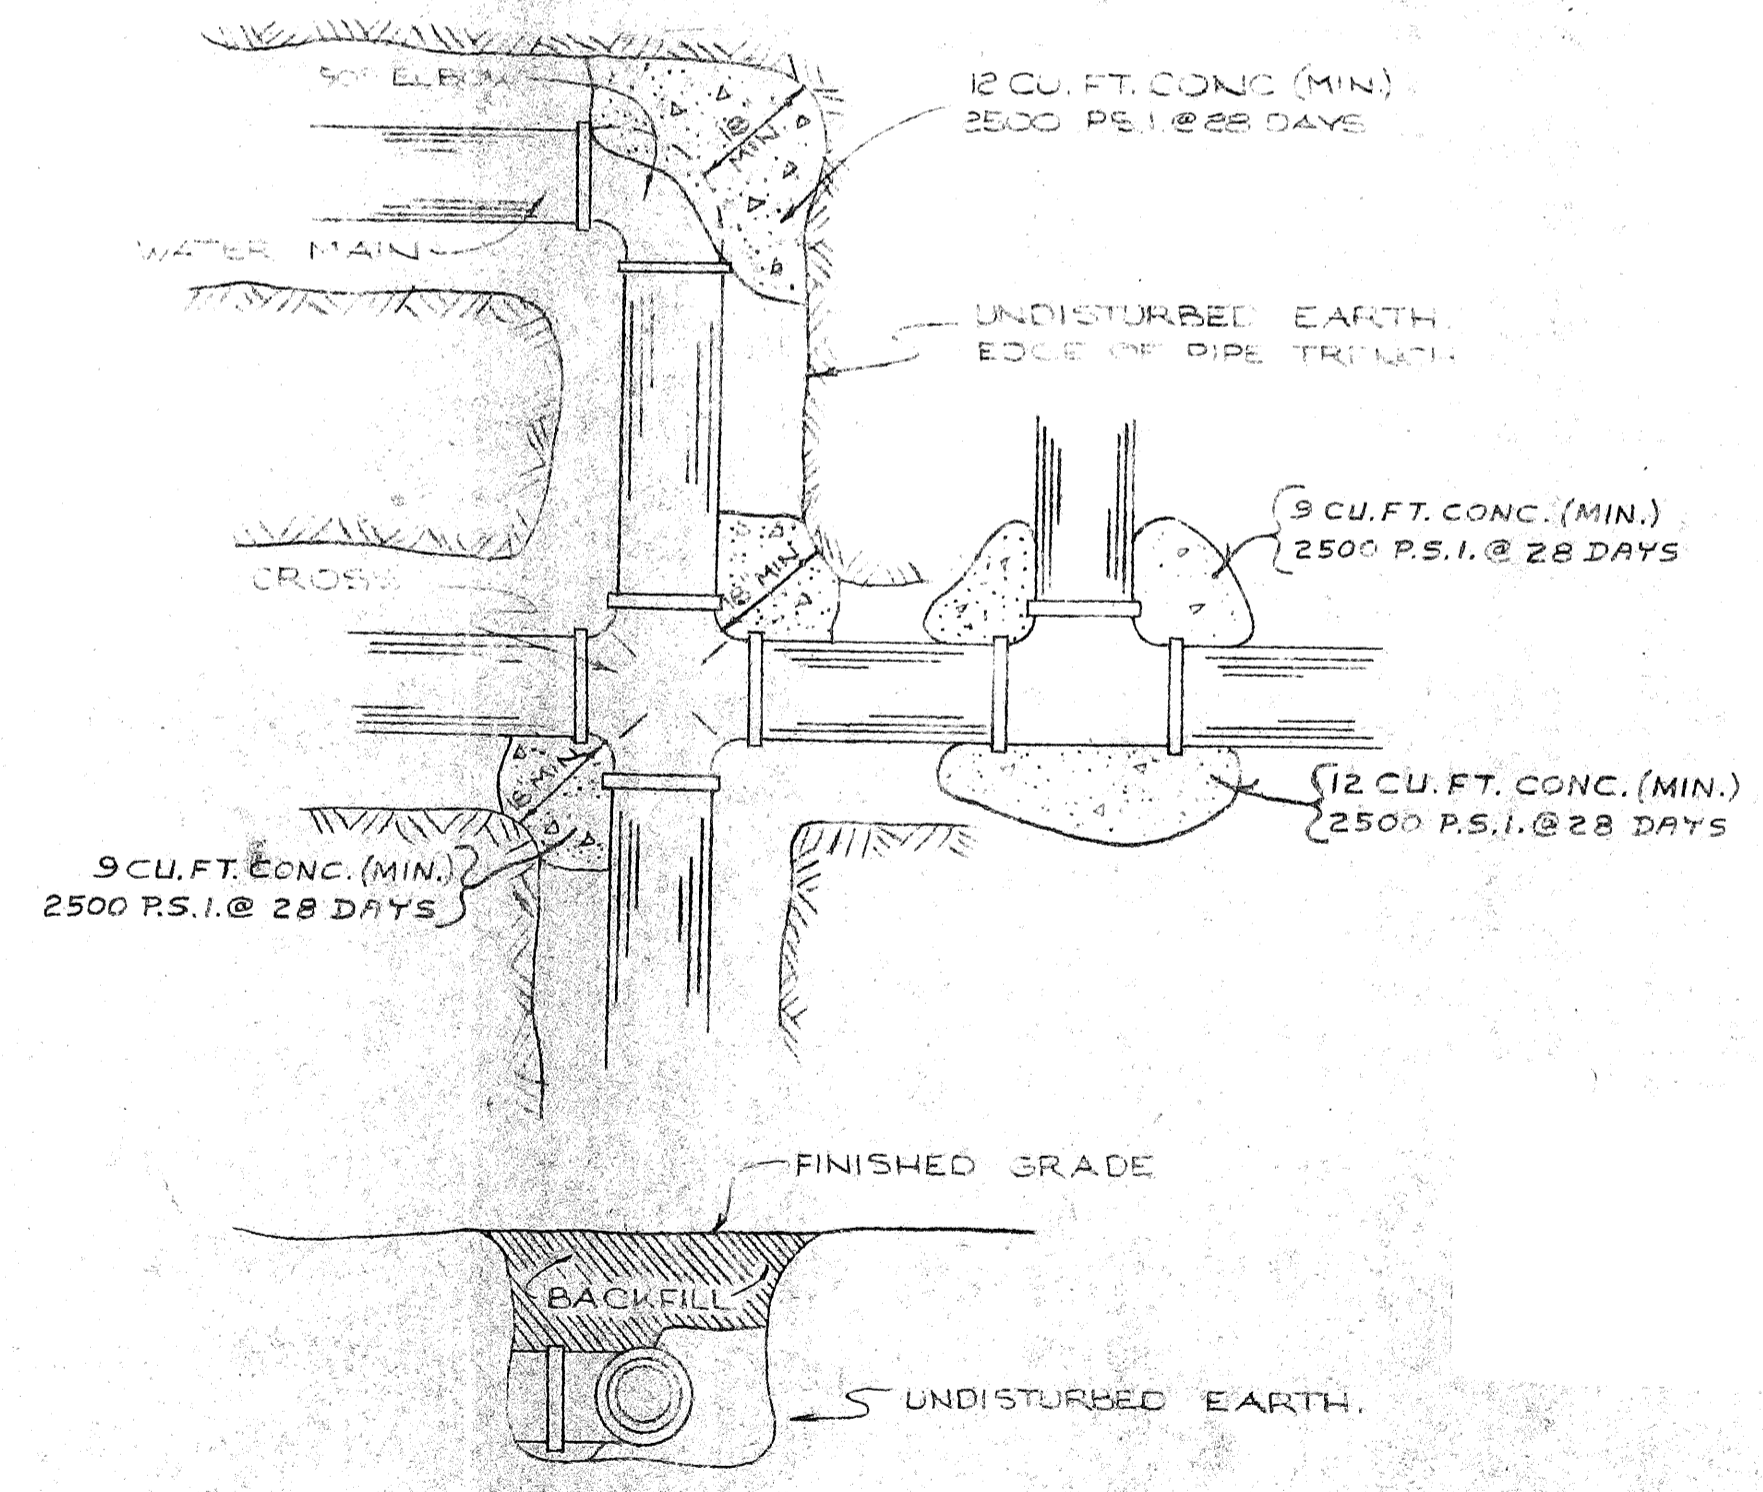

TYPICAL THRUST BLOCK DETAIL
NO SCALE

- NOTE:
1. WHERE WATER AND SEWER MAINS CROSS WITHIN 18" VERTICAL CLEARANCE, THE SEWER MAINS WILL BE ENCASED IN CONCRETE (SEE SEWER CONSTRUCTION DETAIL)
 2. WHEN A WATER MAIN PARALLELS A SEWER MAIN, A SEPARATION OF AT LEAST 10 FT. SHALL BE MAINTAINED.

WATER CONSTRUCTION DETAILS

FOR
HIDEAWAY BAY

IN
SEC 23 TWP 35 S., RGE. 16 E.
MANATEE COUNTY, FLORIDA
FOR: COMPASS DEVELOPMENT CORP

DESIGNED	R.J.L.	DATE	10-26-75
DRAWN	R.W.	JOB NO.	123
CHECKED	R.J.L. & M.S.D.	SCALE	
APPROVED	R.J.L.	SHEET	2 OF 2
REVISED			
1.		3.	
2.		4.	

ROBERTS & ZOLLER, INC.
CONSULTING ENGINEERS
ENGINEERING, SURVEYING, PLANNING
P.O. Box 12
BRADENTON, FLORIDA 33506

Robert Roberts