


92'-2"

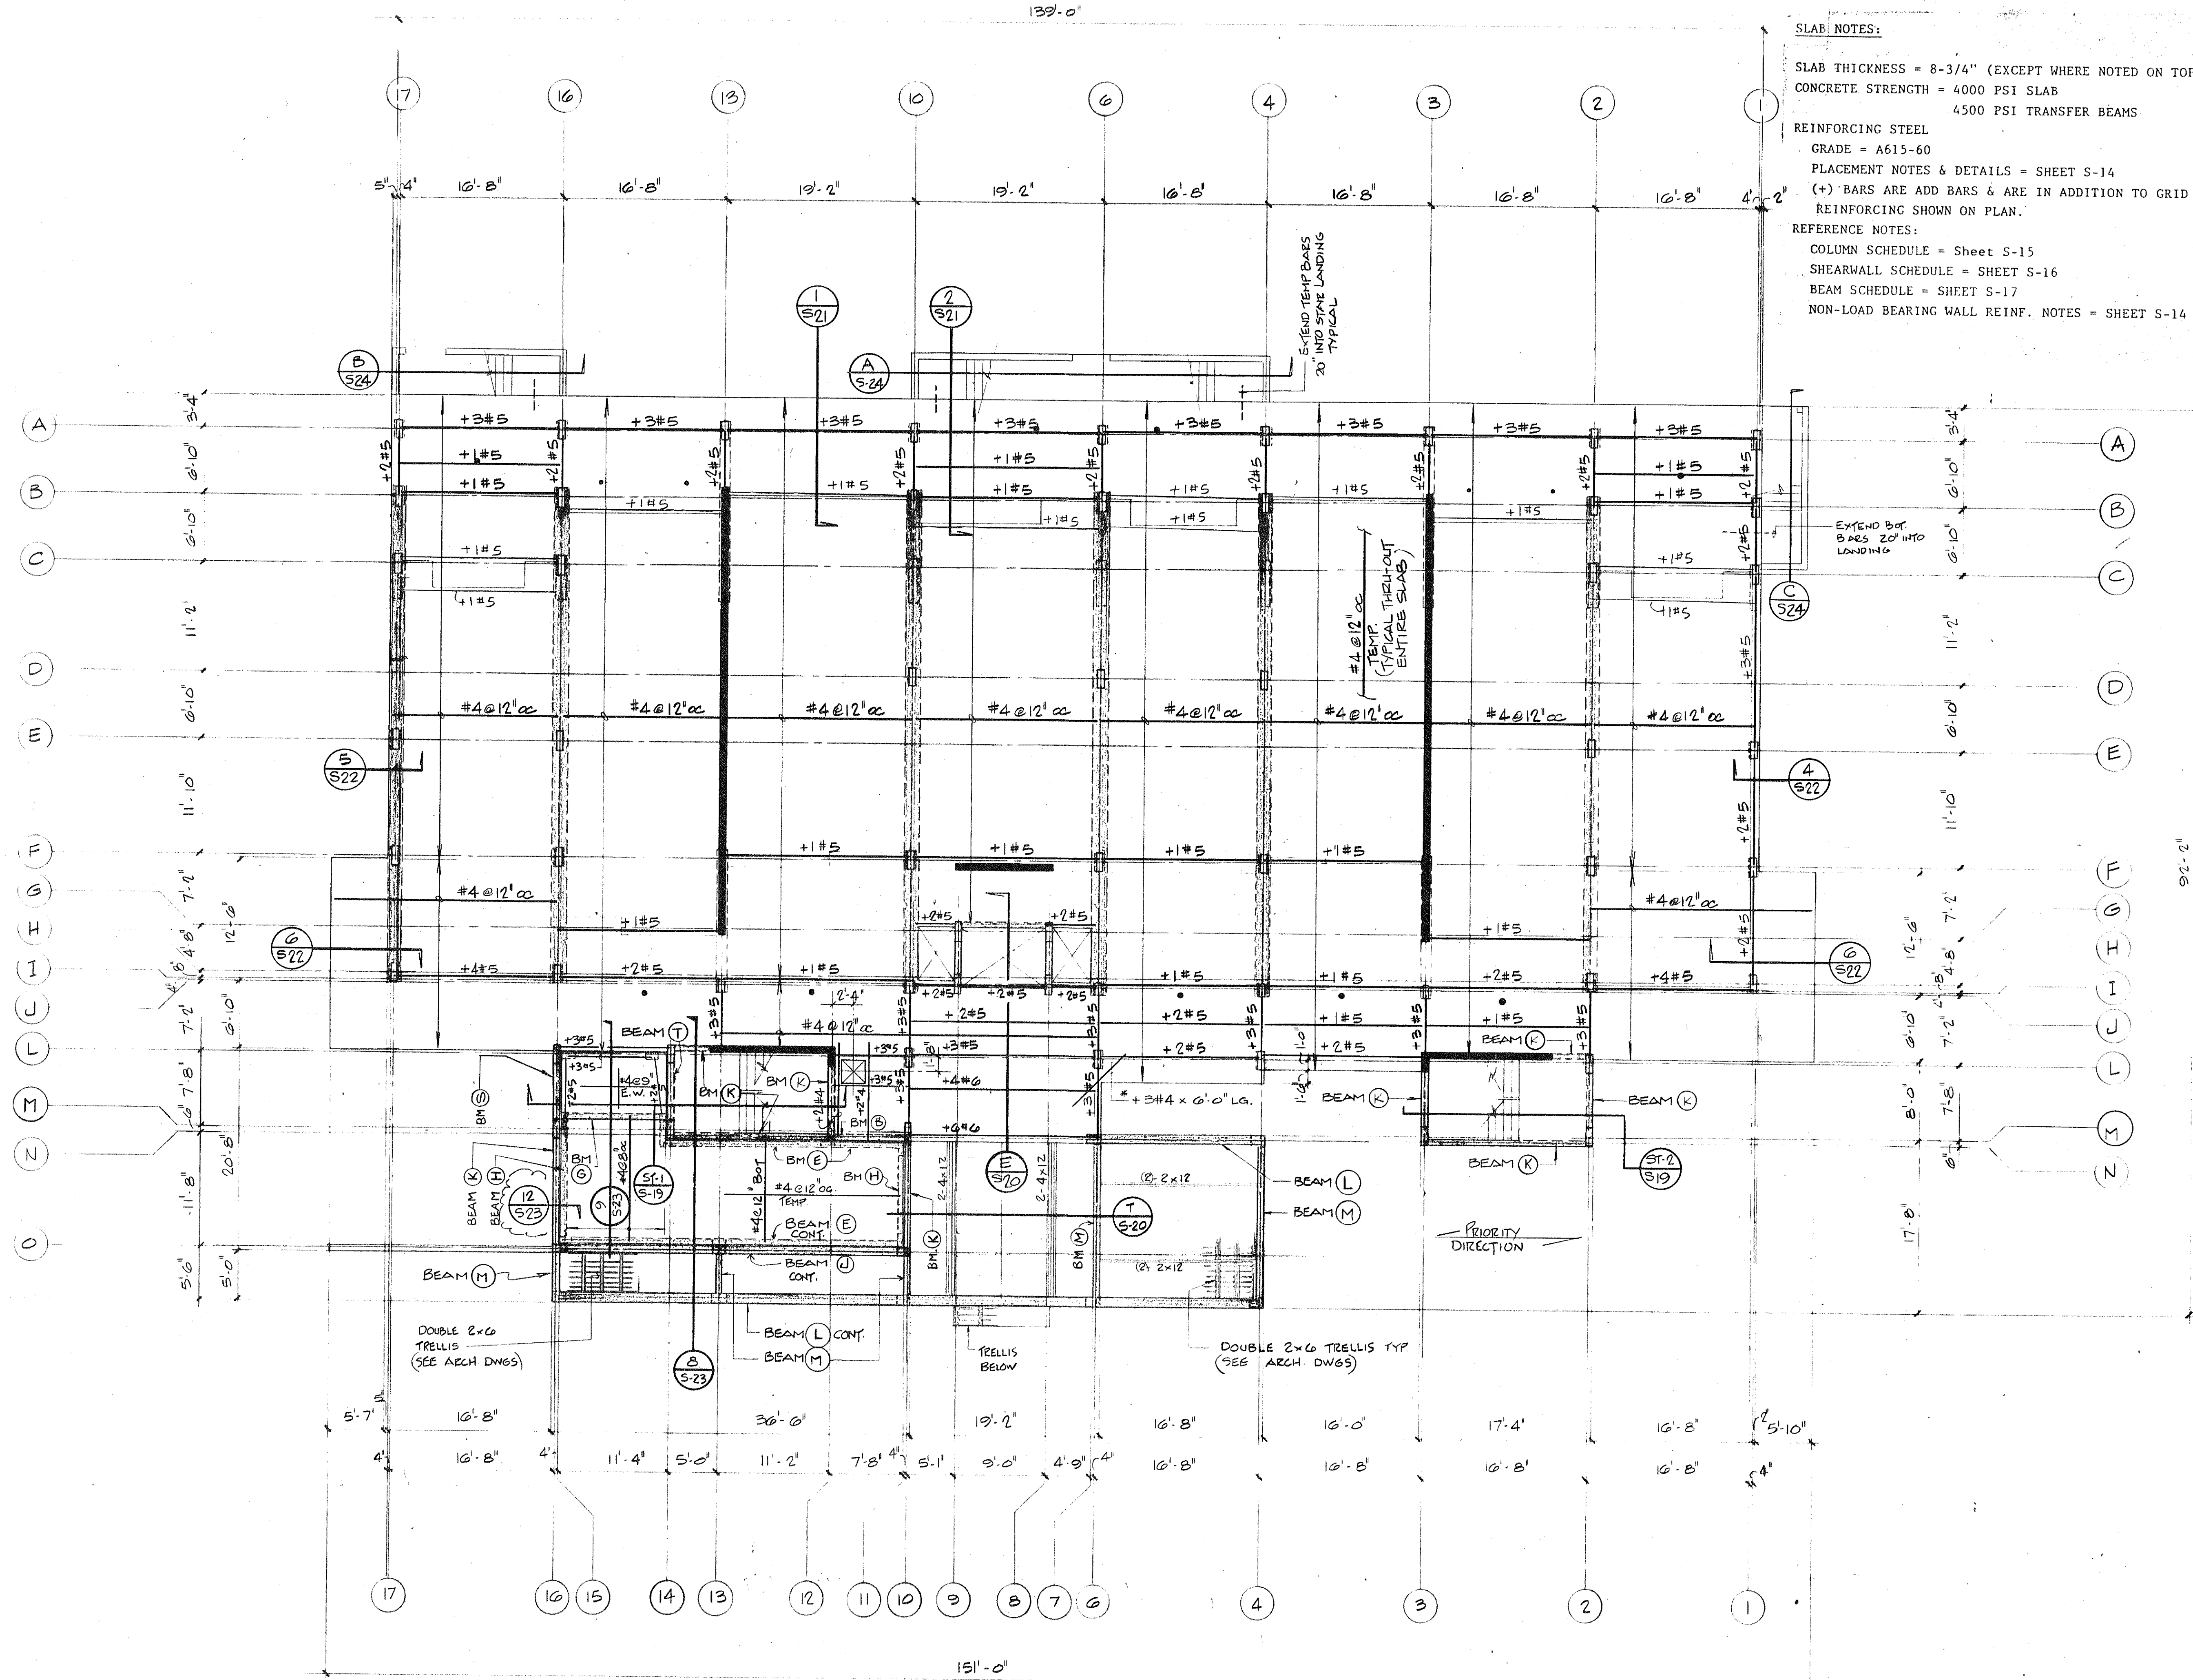

SLAB NOTES:
 SLAB THICKNESS = 8-3/4" (EXCEPT WHERE NOTED ON TOP STEEL SHEET)
 CONCRETE STRENGTH = 4000 PSI SLAB
 4500 PSI TRANSFER BEAMS
 REINFORCING STEEL
 GRADE = A615-60
 PLACEMENT NOTES & DETAILS = SHEET S-14
 (+) BARS ARE ADD BARS & ARE IN ADDITION TO GRID
 REINFORCING SHOWN ON PLAN.
 REFERENCE NOTES:
 COLUMN SCHEDULE = SHEET S-15
 SHEARWALL SCHEDULE = SHEET S-16
 BEAM SCHEDULE = SHEET S-17
 NON-LOAD BEARING WALL REINF. NOTES = SHEET S-14

BUILDING - 2
 FIRST FLOOR
 BOTTOM STEEL PLAN
 1/8"=1'-0"

| | |
|---------|----------|
| ISSUED | 12-10-82 |
| REVISED | 1-4-83 |
| | 4-1-83 |
| SHEET | S4 |
| OF | |

SUNSET BEACH
 OF LONG BEACH KEY
 BENNETT & BISHOP, INC. CONSULTING ENGINEERS & SURVEYORS

ARVIDA CORPORATION, EDWARD J. SEBERT, AIA, ARCHITECT & PLANNER, P.A., THE SWA GROUP
 BRABHAM, KUHN, DEBAY, CONSULTING ENGINEERS, OLSEN, WHITE & ASSOCIATES, STRUCTURAL ENGINEERS