


**SLAB NOTES:**

SLAB THICKNESS = 8-3/4" (EXCEPT WHERE NOTED)  
 CONCRETE STRENGTH = 4000 PSI SLAB  
 4500 PSI TRANSFER BEAMS

REINFORCING STEEL  
 GRADE = A615-60  
 PLACEMENT NOTES & DETAILS = SHEET S-14  
 (+) BARS ARE ADD BARS & ARE IN ADDITION TO GRID REINFORCING SHOWN ON PLAN.

REFERENCE NOTES:  
 COLUMN SCHEDULE = SHEET S-15  
 SHEARWALL SCHEDULE = SHEET S-16  
 BEAM SCHEDULE = SHEET S-17  
 NON-LOAD BEARING WALL REINF. NOTES = SHEET S-14

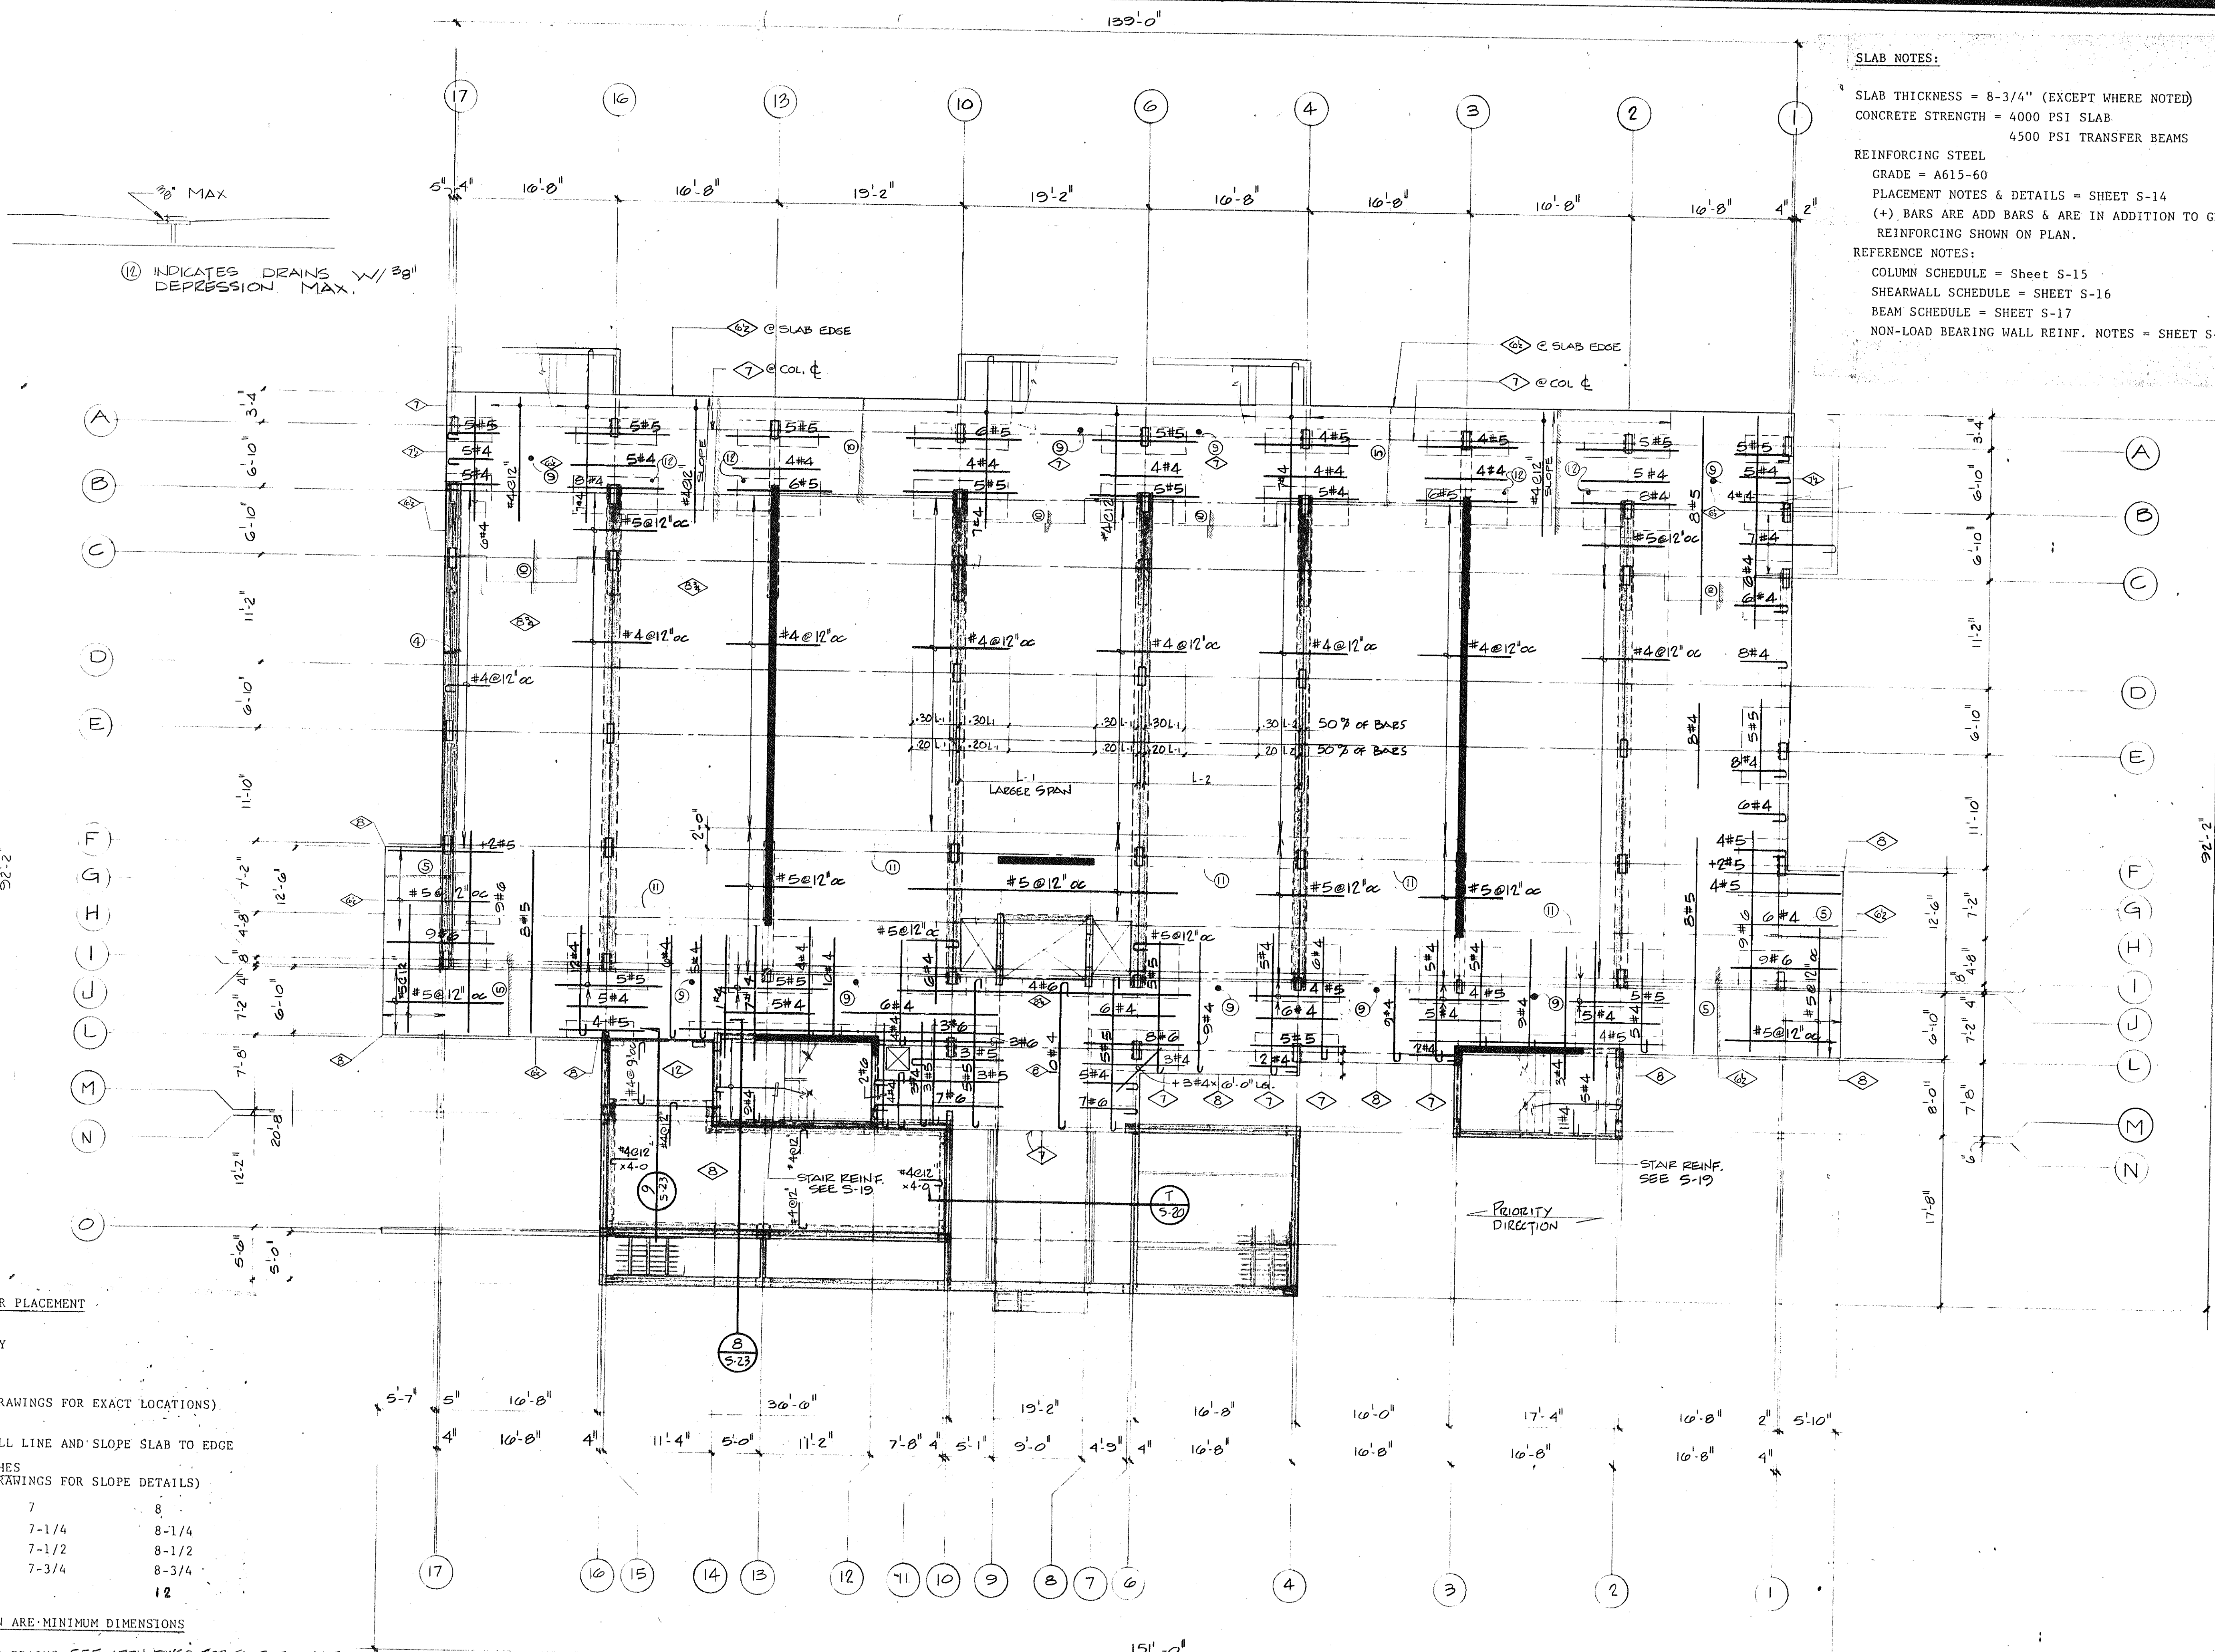

**LEGEND**

**CHANGE IN PRIORITY BAR PLACEMENT**

① FIRST PRIORITY  
 ② SECOND PRIORITY  
 ③ THIRD PRIORITY

**SLAB STEPS AND SLOPES**  
 (SEE ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS)

④ 3/4" DAP OUT  
 ⑤ 3/4" STEP @ WALL LINE AND SLOPE SLAB TO EDGE

**SLAB THICKNESS IN INCHES**  
 (SEE ARCHITECTURAL DRAWINGS FOR SLOPE DETAILS)

5-1/2	7	8
6	7-1/4	8-1/4
6-1/2	7-1/2	8-1/2
6-3/4	7-3/4	8-3/4

12

SLAB THICKNESSES SHOWN ARE MINIMUM DIMENSIONS  
 GENERAL

⑨ INDICATES FLOOR DRAINS - SEE ARCH. DWGS FOR SLAB THICKNESS @ DRAINS  
 ⑩ 3/4" STEP AT WALL LINE AND SLOPE TO DRAIN  
 ⑪ INDICATES UNIT LINE AND START OF SLOPE TO DRAINS.