

NOTES

THE ELECTRICAL CONTRACTOR SHALL VERIFY ALL ACTUAL SPRINKLER VALVE LOCATIONS AND LOCATE FLOW & TAMPER SWITCHES ACCORDINGLY.

ALL FIRE ALARM SYSTEM SHOP DRAWINGS SHALL BE APPROVED BY LOCAL FIRE DEPARTMENT PRIOR TO SUBMISSION TO ARCHITECT.

ALL APARTMENT SMOKE DETECTORS SHALL SHUT DOWN A/C UNIT ON ALARM; ONE SMOKE DETECTOR SHALL BE LOCATED IN RETURN AIR PATH; VERIFY ACTUAL LOCATION WITH FIRE DEPARTMENT.


FIRE ALARM LEGEND

- ◇ SMOKE DETECTOR CEILING MOUNTED
- ◇ SMOKE DETECTOR - INTERLOCK WITH ELEVATOR CONTROLS
- ◇ SMOKE DETECTOR - DUCT MOUNTED
- R AIR HANDLER SHUT DOWN RELAY
- HK FIRE ALARM HORN - SINGLE OR DOUBLE PROJECTOR AS SHOWN
- F MANUAL PULL STATION MOUNTED 54" A.F.F.
- ◇ GENERATOR STATUS INDICATOR CONNECTION
- ◇ TELEPHONE JACK MOUNTED 54" A.F.F.
- F FLOW SWITCH MOUNTED ON SPRINKLER PIPE
- ↑ TAMPER SWITCH MOUNTED ON SPRINKLER VALVE
- ◇ ILLUMINATED SIGN TO READ "EMERGENCY USE STAIRS"
- ◇ FLUSH MOUNTED CEILING SPEAKER
- ◇ ELEVATOR INTERLOCK

APT. SMOKE DETECTOR ANNUNCIATORS	ELEVATOR STATUS PANEL
SMOKE DETECTOR & PULL STATION ANNUNCIATORS	EM. GEN. STATUS PANEL & CONTROL
FLOW & TAMPER SWITCH ANNUNCIATOR PANEL	FIRE PUMP STATUS
VOICE PANEL W/ MICROPHONE & TAPE, ZONE & ALL CALL SEL.	TELEPHONE PNL. FIREMAN'S
ALARM PANEL & ZONE LIGHTS	TROUBLE PANEL
INTERCOM PANEL	CENTRAL STATION PANEL
SPACE	SPACE

FIRE ALARM PANEL

n.t.s. CONTROL LOCATIONS MAY VARY

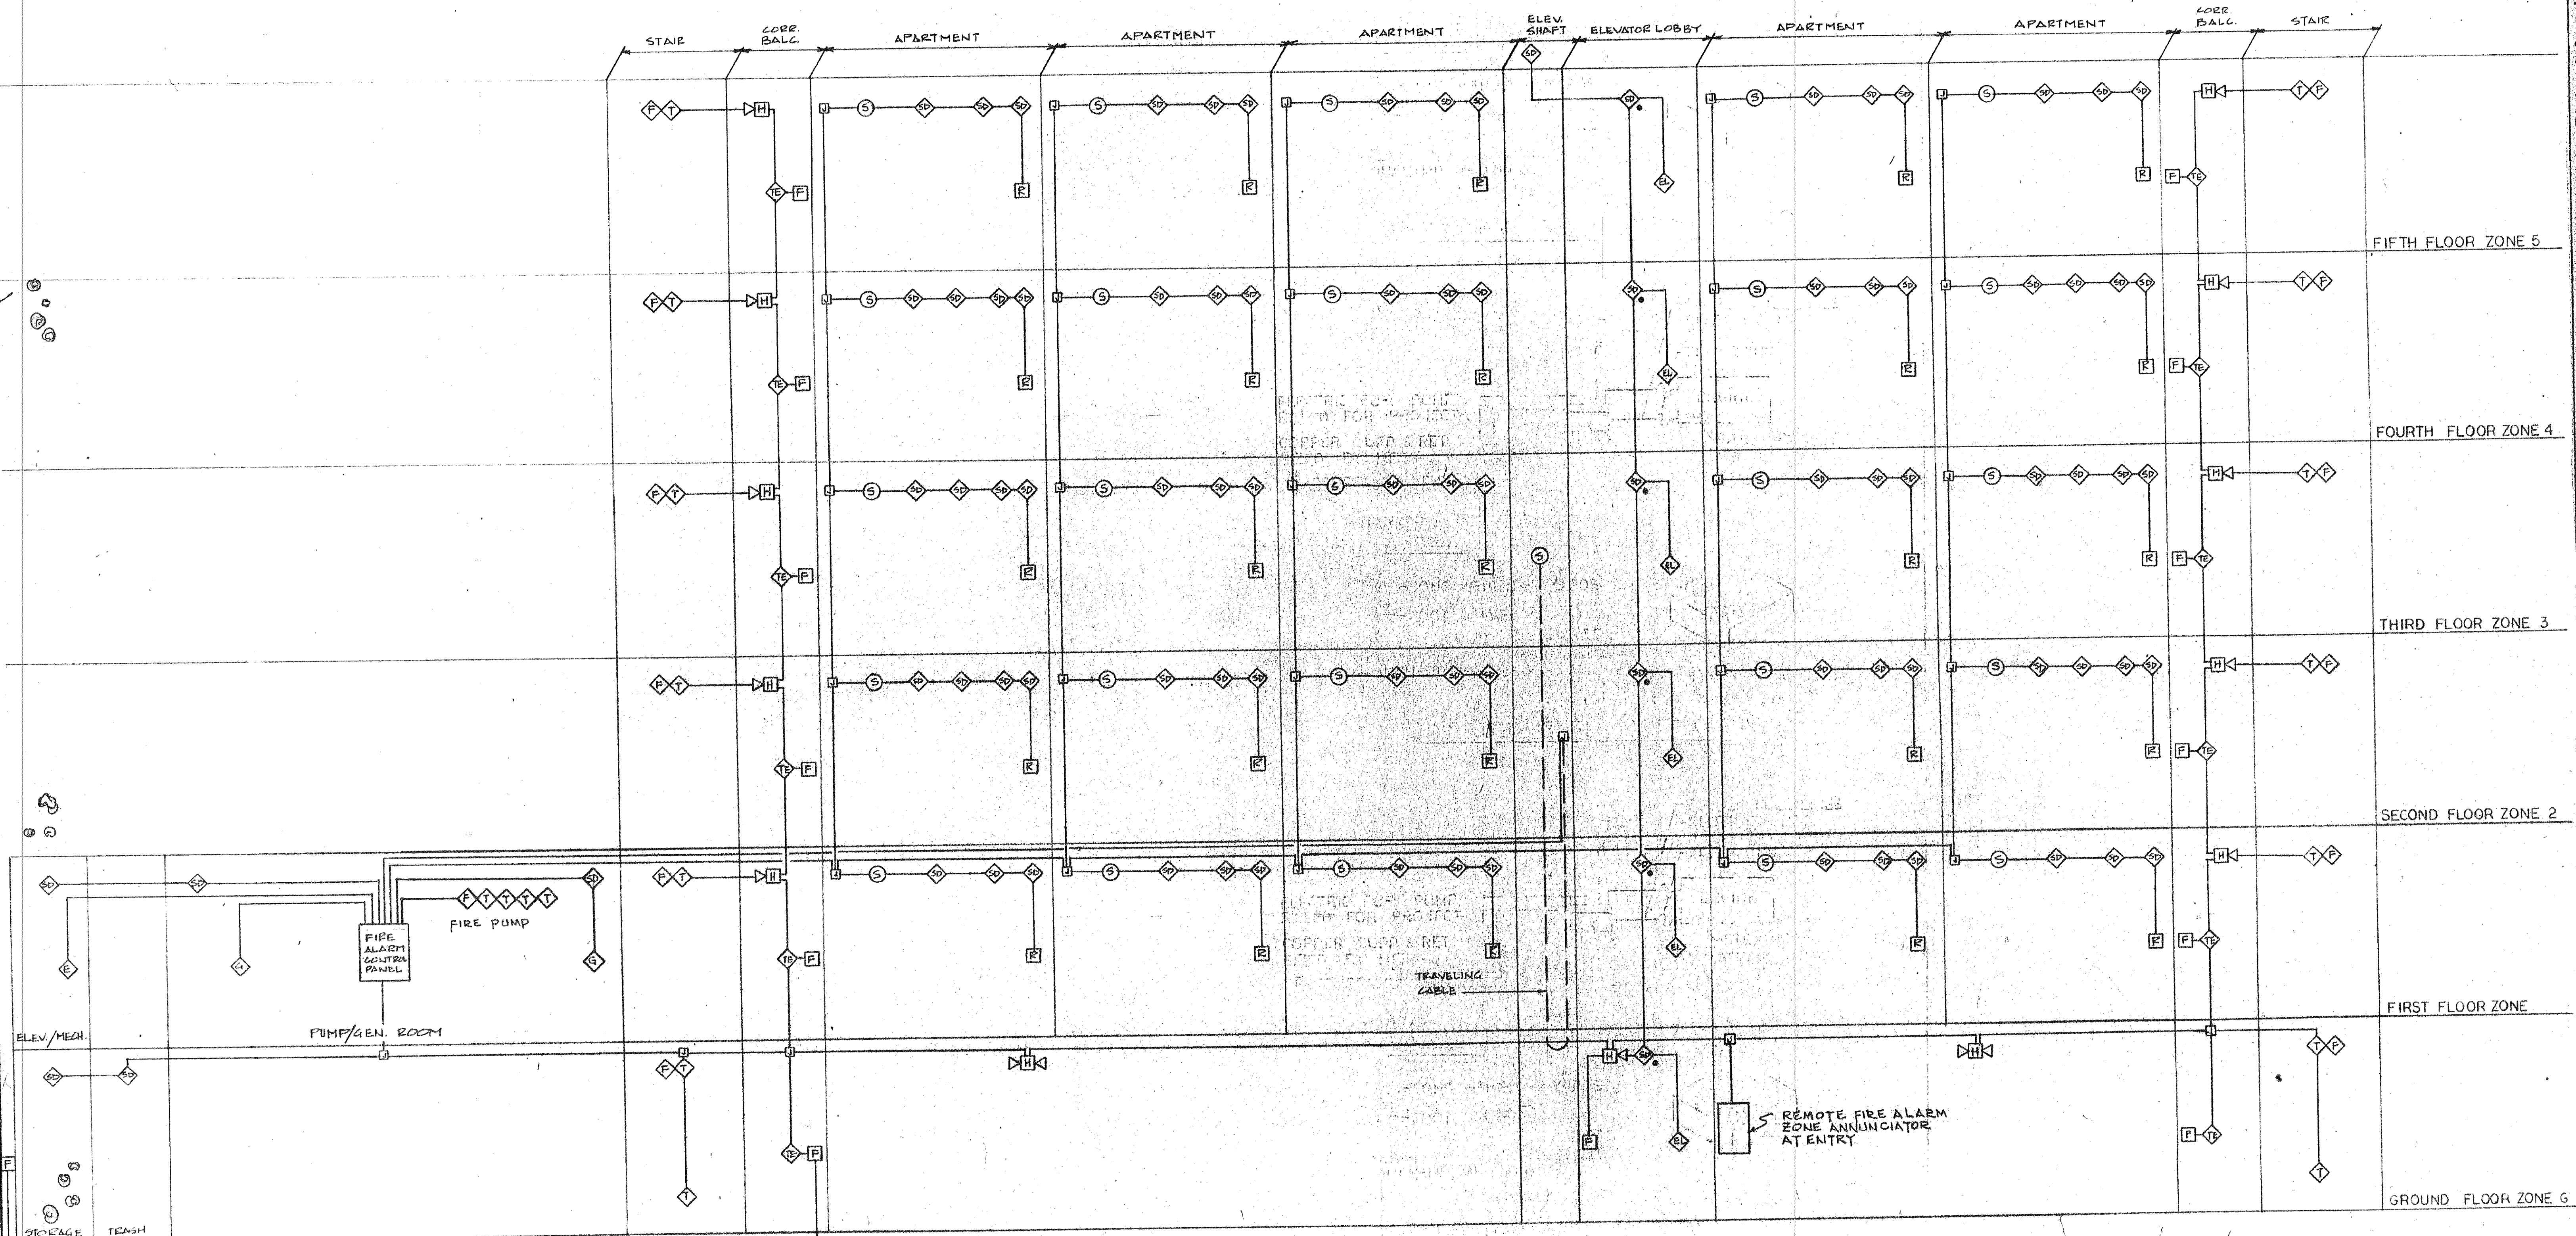

FIRE ALARM RISER

n.t.s.

SUNSET BEACH
 LONG BEACH BOAT KEY
 BENNETT & BISHOP INC CONSULTING ENGINEERS & SURVEYORS

ARVIDA CORPORATION EDWARD J. SEIBERT AIA ARCHITECT & PLANNER, P.A. THE SWA GROUP
 BRADHAM KUHN DEBAY CONSULTING ENGINEERS OLSEN WHITE & ASSOCIATES STRUCTURAL ENGINEERS

ISSUED	41
REVISED	
SHEET	E-16
BLDG.	3
OF	