NOTES

1- THE ELECTRICAL CONTRACTOR SHALL VERIFY ALL ACTUAL SPRINKLER VALVE LOCATIONS AND LOCATE FLOW & TAMPER SWITCHES ACCORDINGLY.

2- ALL FIRE ALARM SYSTOM SHOP DRAWINGS SHALL BE APPROVED BY LOCAL FIRE DEPARTMENT PRIOR TO SUBMISSION TO ARCHITECT.

3- ALL APARTMENT SMOKE DETECTORS SHALL SHUT DOWN A/C UNIT ON ALARM; ONE SMOKE DETECTOR SHALL BE LOCATED IN RETURN AIR PATH; VERIFY ACTUAL LOCATION WITH FIRE DEPARTMENT.

FIRE ALARM LEGEND

- SD — SMOKE DETECTOR CEILING MOUNTED
- SD — SMOKE DETECTOR - INTERLOCK WITH ELEVATOR CONTROLS
- SD — SMOKE DETECTOR - DUCT MOUNTED
- R — AIR HANDLER SHUT DOWN RELAY
- H — FIRE ALARM HORN - SINGLE OR DOUBLE PROJECTOR AS SHOWN
- F — MANUAL PULL STATION MOUNTED 54" A.F.F.
- G — GENERATOR STATUS INDICATOR CONNECTION
- TE — TELEPHONE JACK MOUNTED 54" A.F.F.
- F — FLOW SWITCH MOUNTED ON SPRINKLER PIPE
- T — TAMPER SWITCH MOUNTED ON SPRINKLER VALVE
- EL — ILLUMINATED SIGN TO READ "EMERGENCY USE STAIRS"
- S — FLUSH MOUNTED CEILING SPEAKER
- E — ELEVATOR INTERLOCK

APT. SMOKE DETECTOR ANNUNCIATORS	ELEVATOR STATUS PANEL
SMOKE DETECTOR & PULL STATION ANNUNCIATORS	EM. GEN. STATUS PANEL & CONTROL
FLOW & TAMPER SWITCH ANNUNCIATOR PANEL	FIRE PUMP STATUS
VOICE PANEL W/MICRO-PHONE & TAPE, ZONE & ALL CALL SEL.	TELEPHONE FNL. OUTSIDE → FIREMAN'S
ALARM PANEL & ZONE LIGHTS	TROUBLE PANEL
INTERCOM PANEL	CENTRAL STATION PANEL
SPACE	SPACE

FIRE ALARM PANEL

n.t.s. CONTROL LOCATIONS MAY VARY

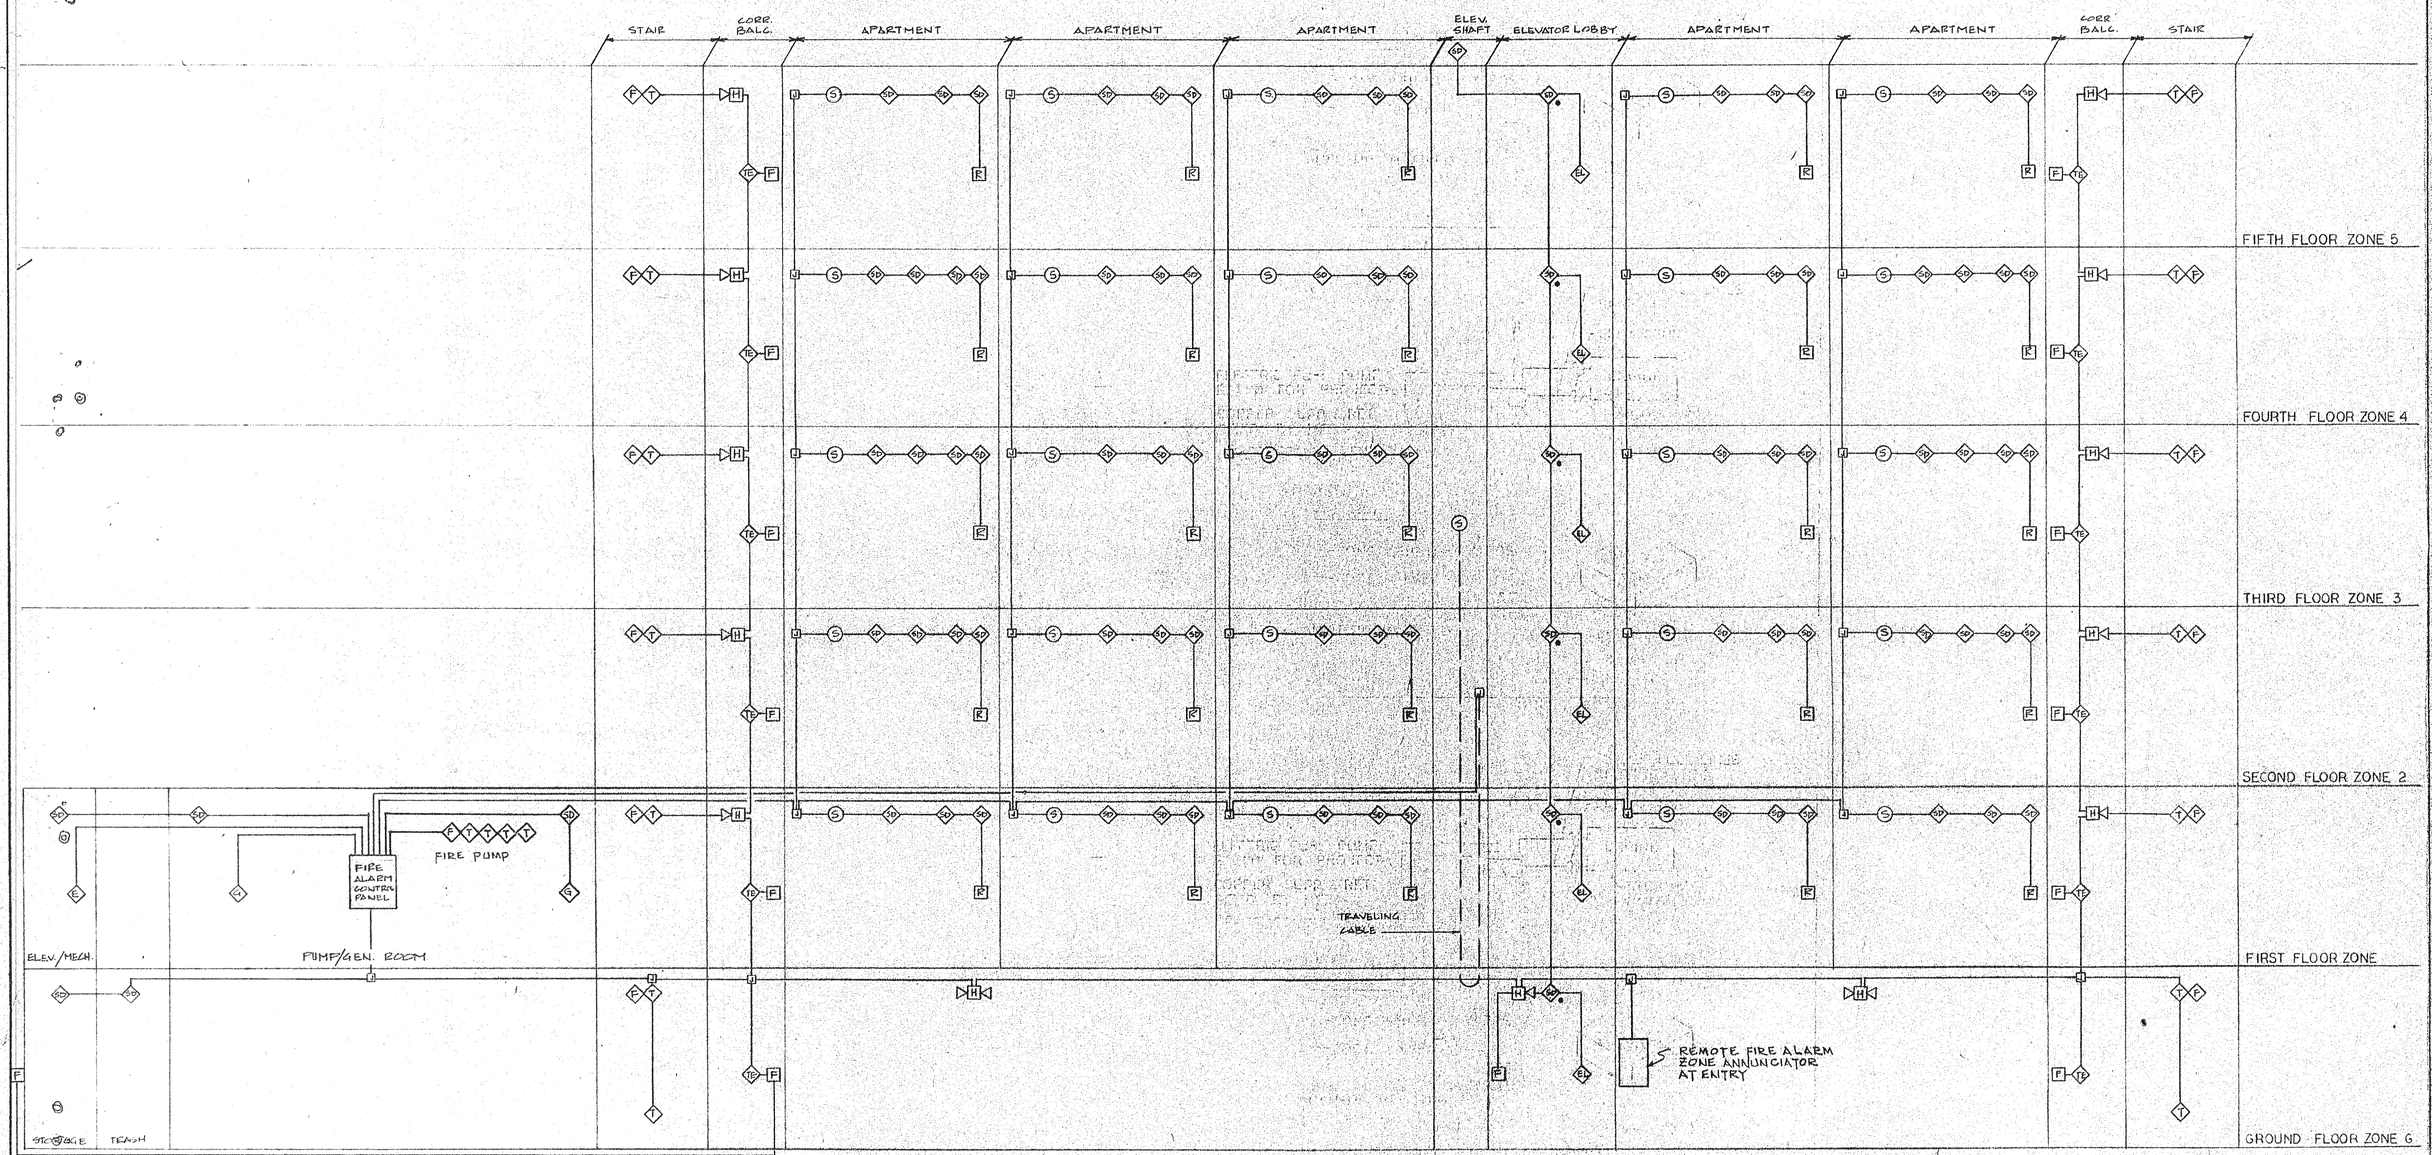

FIRE ALARM RISER

n.t.s.

SUNSET BEACH OF LONGBOAT KEY

ARVIDA CORPORATION - EDWARD J. SEIBERT AIA ARCHITECT & PLANNER PA; THE SWA GROUP
BRAGHAM, KUHNS, DERBY, CONSULTING ENGINEERS - OLSEN, WHITE & ASSOCIATES STRUCTURAL ENGINEERS - BENNETT & BISHOP, INC. CONSULTING ENGINEERS & SURVEYORS

ISSUED 4-1-83

REVISED

SHEET E-16

SHEETS OF