


217'-3"

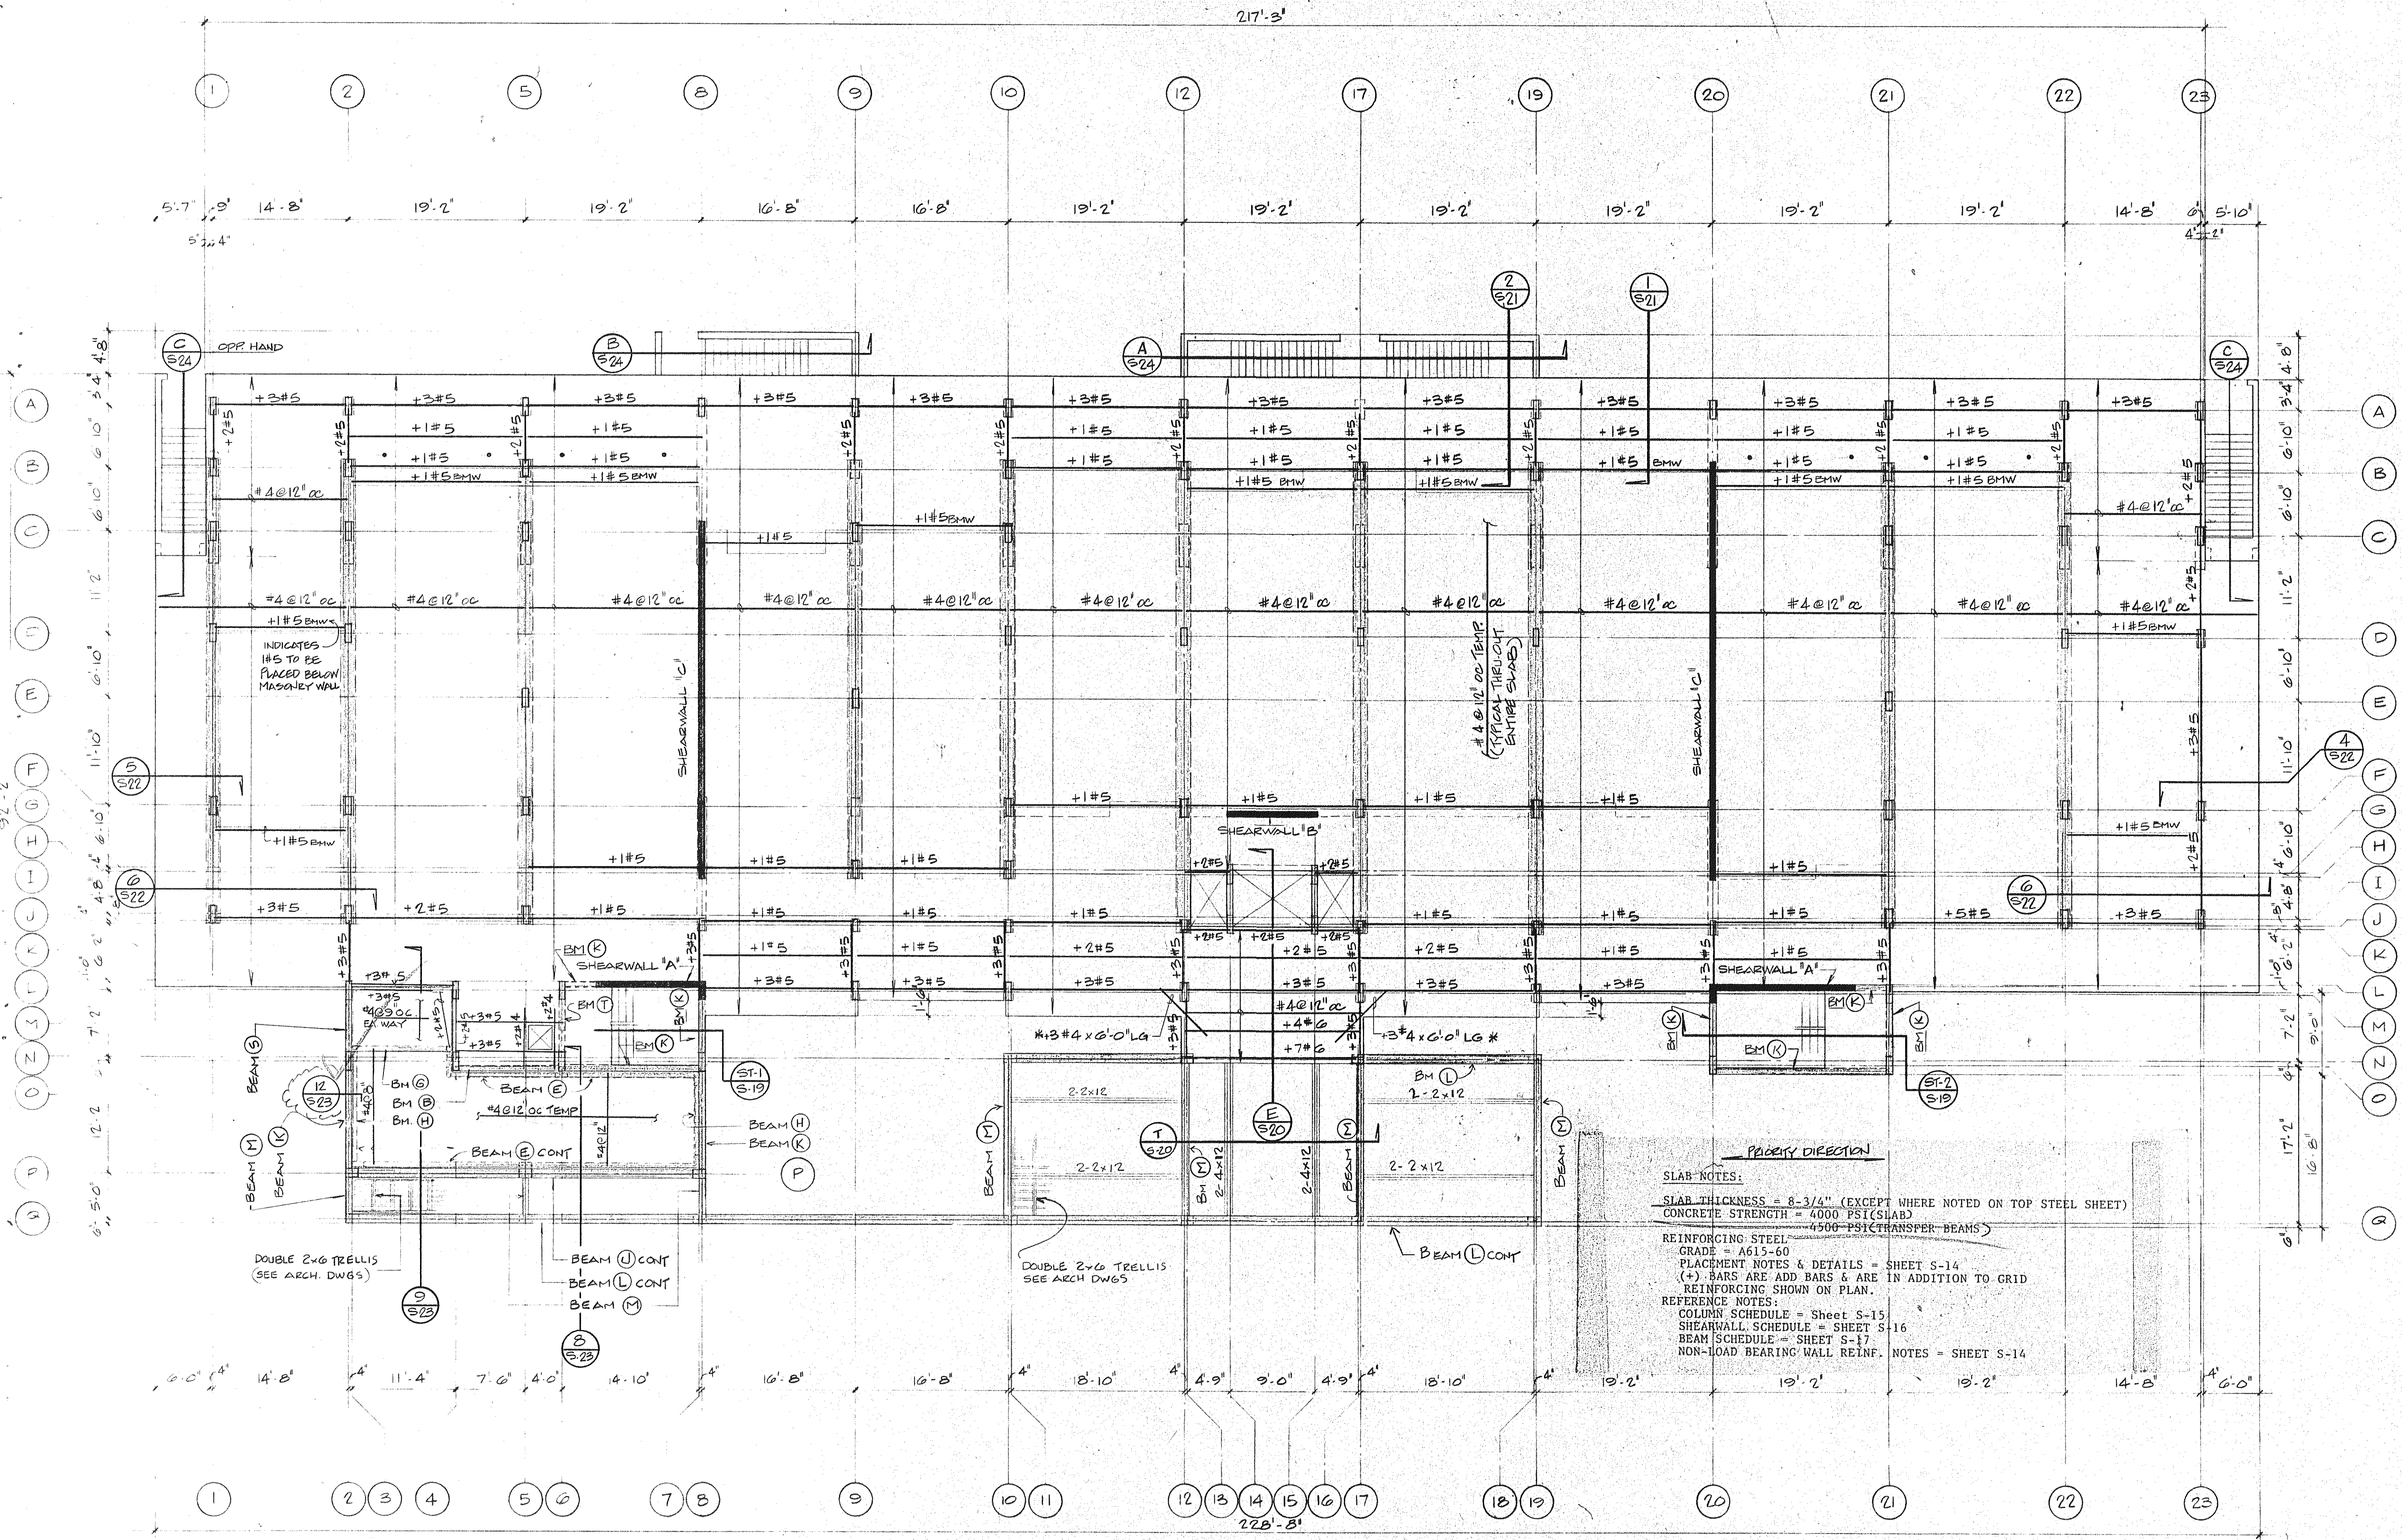

SLAB NOTES:
 SLAB THICKNESS = 8-3/4" (EXCEPT WHERE NOTED ON TOP STEEL SHEET)
 CONCRETE STRENGTH = 4000 PSI (SLAB)
 4500 PSI (TRANSFER BEAMS)

REINFORCING STEEL:
 GRADE = A615-60
 PLACEMENT NOTES & DETAILS = SHEET S-14
 (+) BARS ARE ADD BARS & ARE IN ADDITION TO GRID REINFORCING SHOWN ON PLAN.

REFERENCE NOTES:
 COLUMN SCHEDULE = SHEET S-15
 SHEARWALL SCHEDULE = SHEET S-16
 BEAM SCHEDULE = SHEET S-17
 NON-LOAD BEARING WALL REINF. NOTES = SHEET S-14

SUNSET BEACH
 OF LONG BEACH, CA
 BENNETT & BISHOP INC CONSULTING ENGINEERS & SURVEYORS

BUILDING - 3
FIRST FLOOR BOTTOM
STEEL PLAN
 1/8" = 1'-0"

ISSUED	12-10-82
REVISED	1-4-83
	4-1-83
	11-11-83

SHEET
S4
 OF