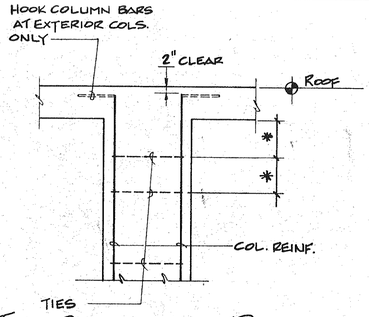

TYP. COLUMN AT ROOF

T = TABLE "T" TENSION SPLICES	
MINIMUM CLASS "C" TENSION SPLICES FOR TIED COLUMNS	
BAR SIZE	LAP IN INCHES
#5	26"
#6	31"
#7	39"
#8	51"
#9	65"

C = TABLE "C" COMPRESSION SPLICES	
MINIMUM LAPPED SPLICE LENGTHS FOR TIED COLUMNS	
BAR SIZE	LAP IN INCHES
#5	16"
#6	19"
#7	22"
#8	25"
#9	28"

TYPICAL SPLICE TABLE
UNLESS NOTED IN SCHEDULE

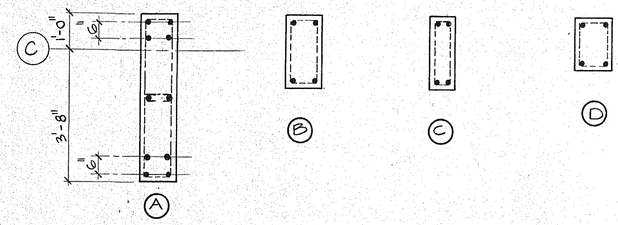

COLUMN BAR PATTERN TYPES

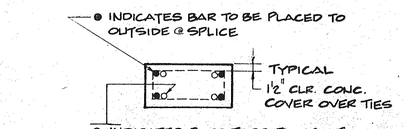

NOTE: BARS TO LAP IN LONG DIRECTION OF COLUMN AS SHOWN.

SECTION X COLUMN @ FLR. SPLICE

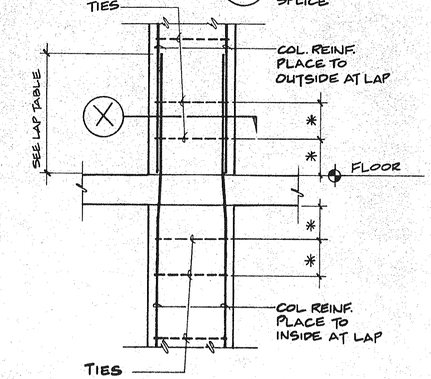

TYP. COLUMN AT FLOOR

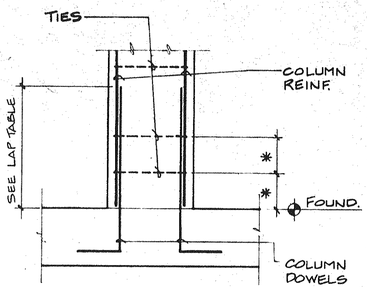

TYP. COLUMN AT FOUND.

* INDICATES ½ TIE SPACING LISTED

COLUMN NOTES:

CONCRETE STRENGTH = 4000 P.S.I.
REINF. STEEL:
GRADE = A615-60
LAP = SEE TABLES

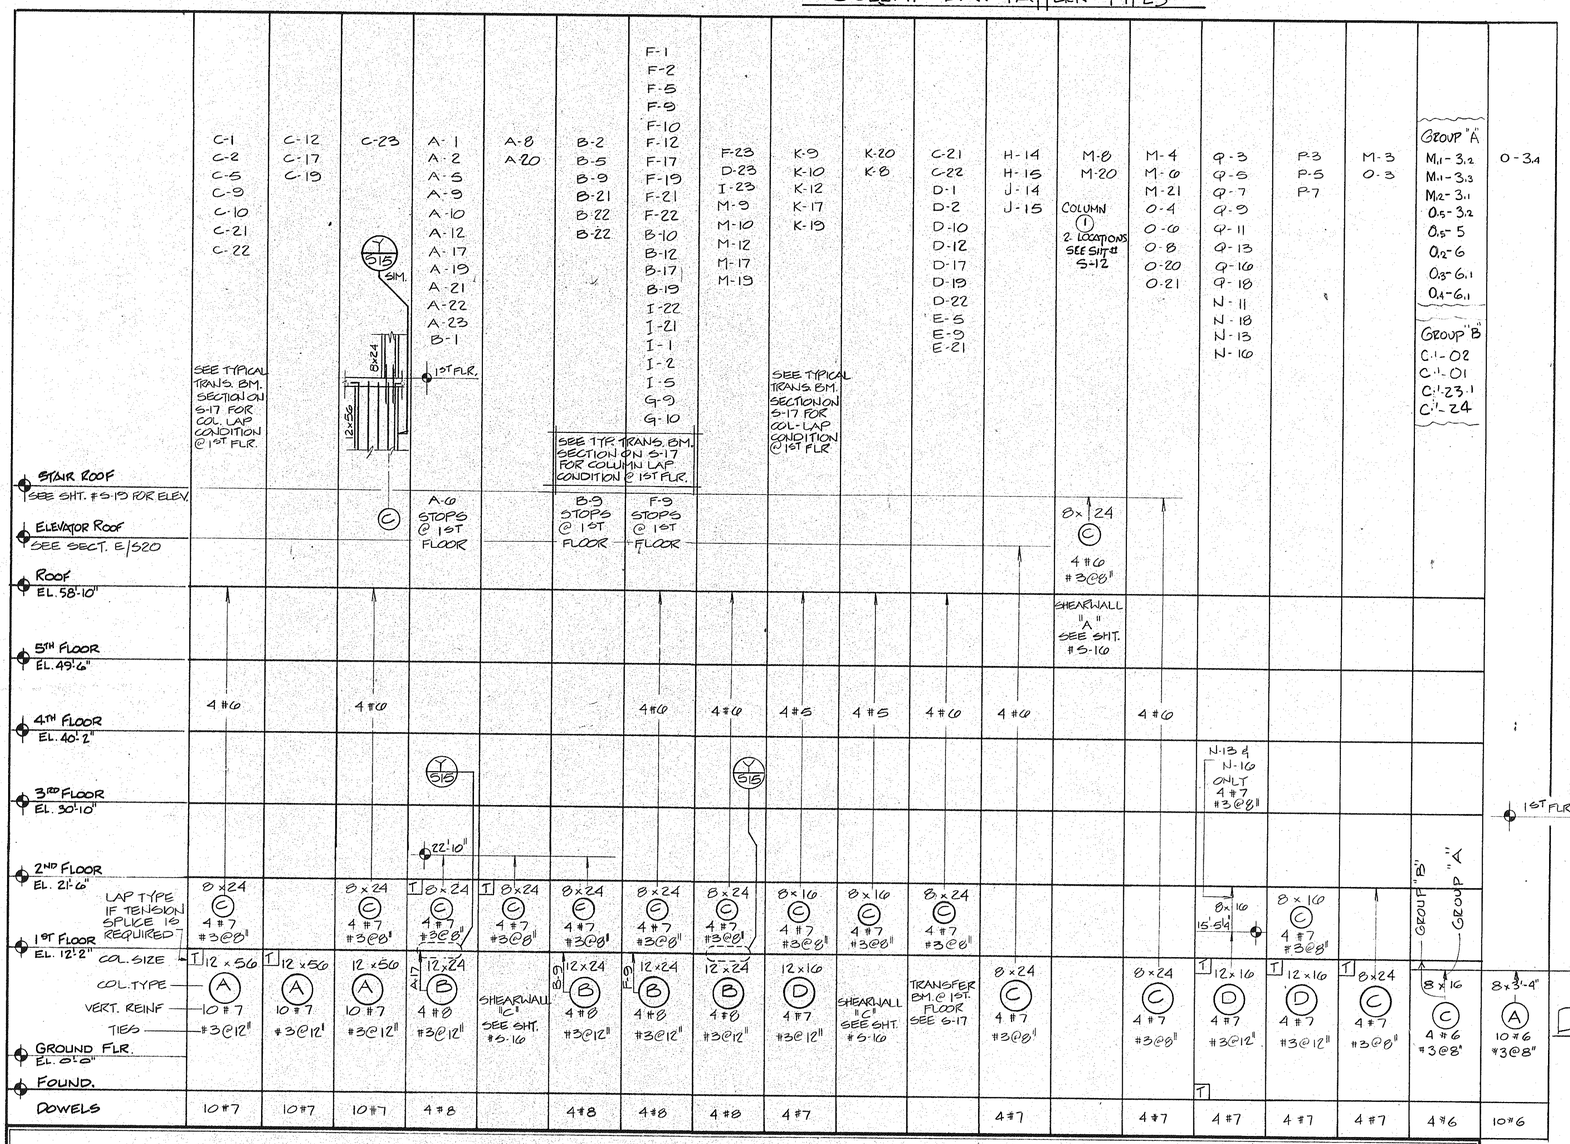

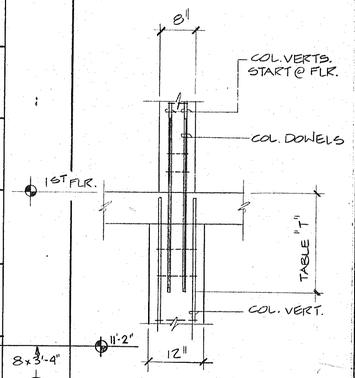

DETAIL Y S-15

COLUMN SCHEDULE

SUNSET BEACH OF LONGBOAT KEY

BLDG. - #3 COLUMN SCHEDULE

ARVIDA CORPORATION : EDWARD J. SEIBERT, AIA ARCHITECT & PLANNER PA. : THE SWA GROUP
BRADHAM KUHNS DEBAY CONSULTING ENGINEERS : OLSEN ASSOCIATES STRUCTURAL ENGINEERS : BENNETT & WHITE & BISHOP INC CONSULTING ENGINEERS & SURVEYORS

ISSUED 12-10-82
REVISED 1-4-83

SHEET S-15 OF 24