




BASE BID:
 PROVIDE 9 SWING JOINTS AND
 50' OF PIPE FOR EACH TANK.
 PROVIDE 35' OF 1" CONDUIT FOR
 EACH TANK'S PUMPS N.I.C.

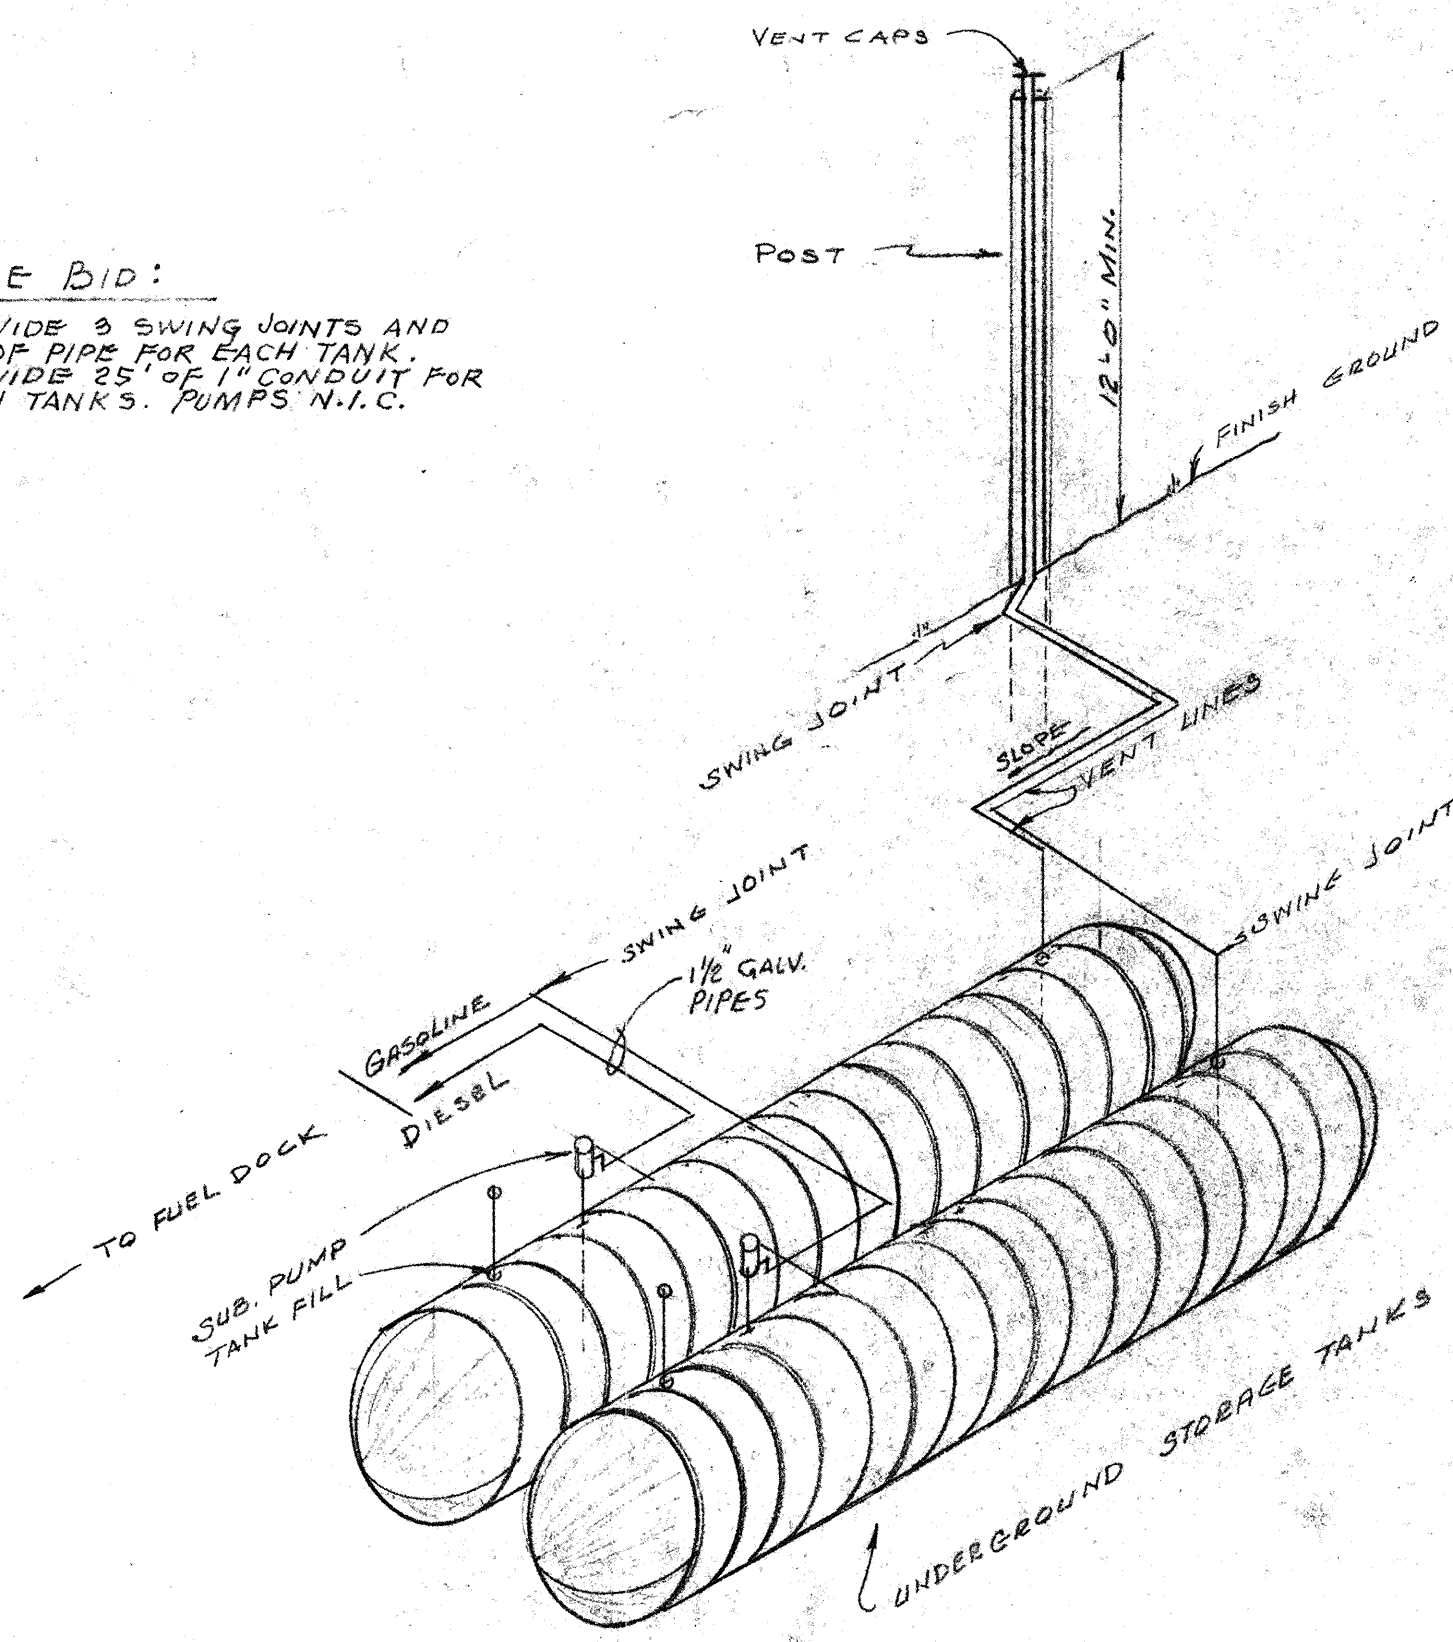

UNDERGROUND PIPING ISOMETRIC
 NO SCALE

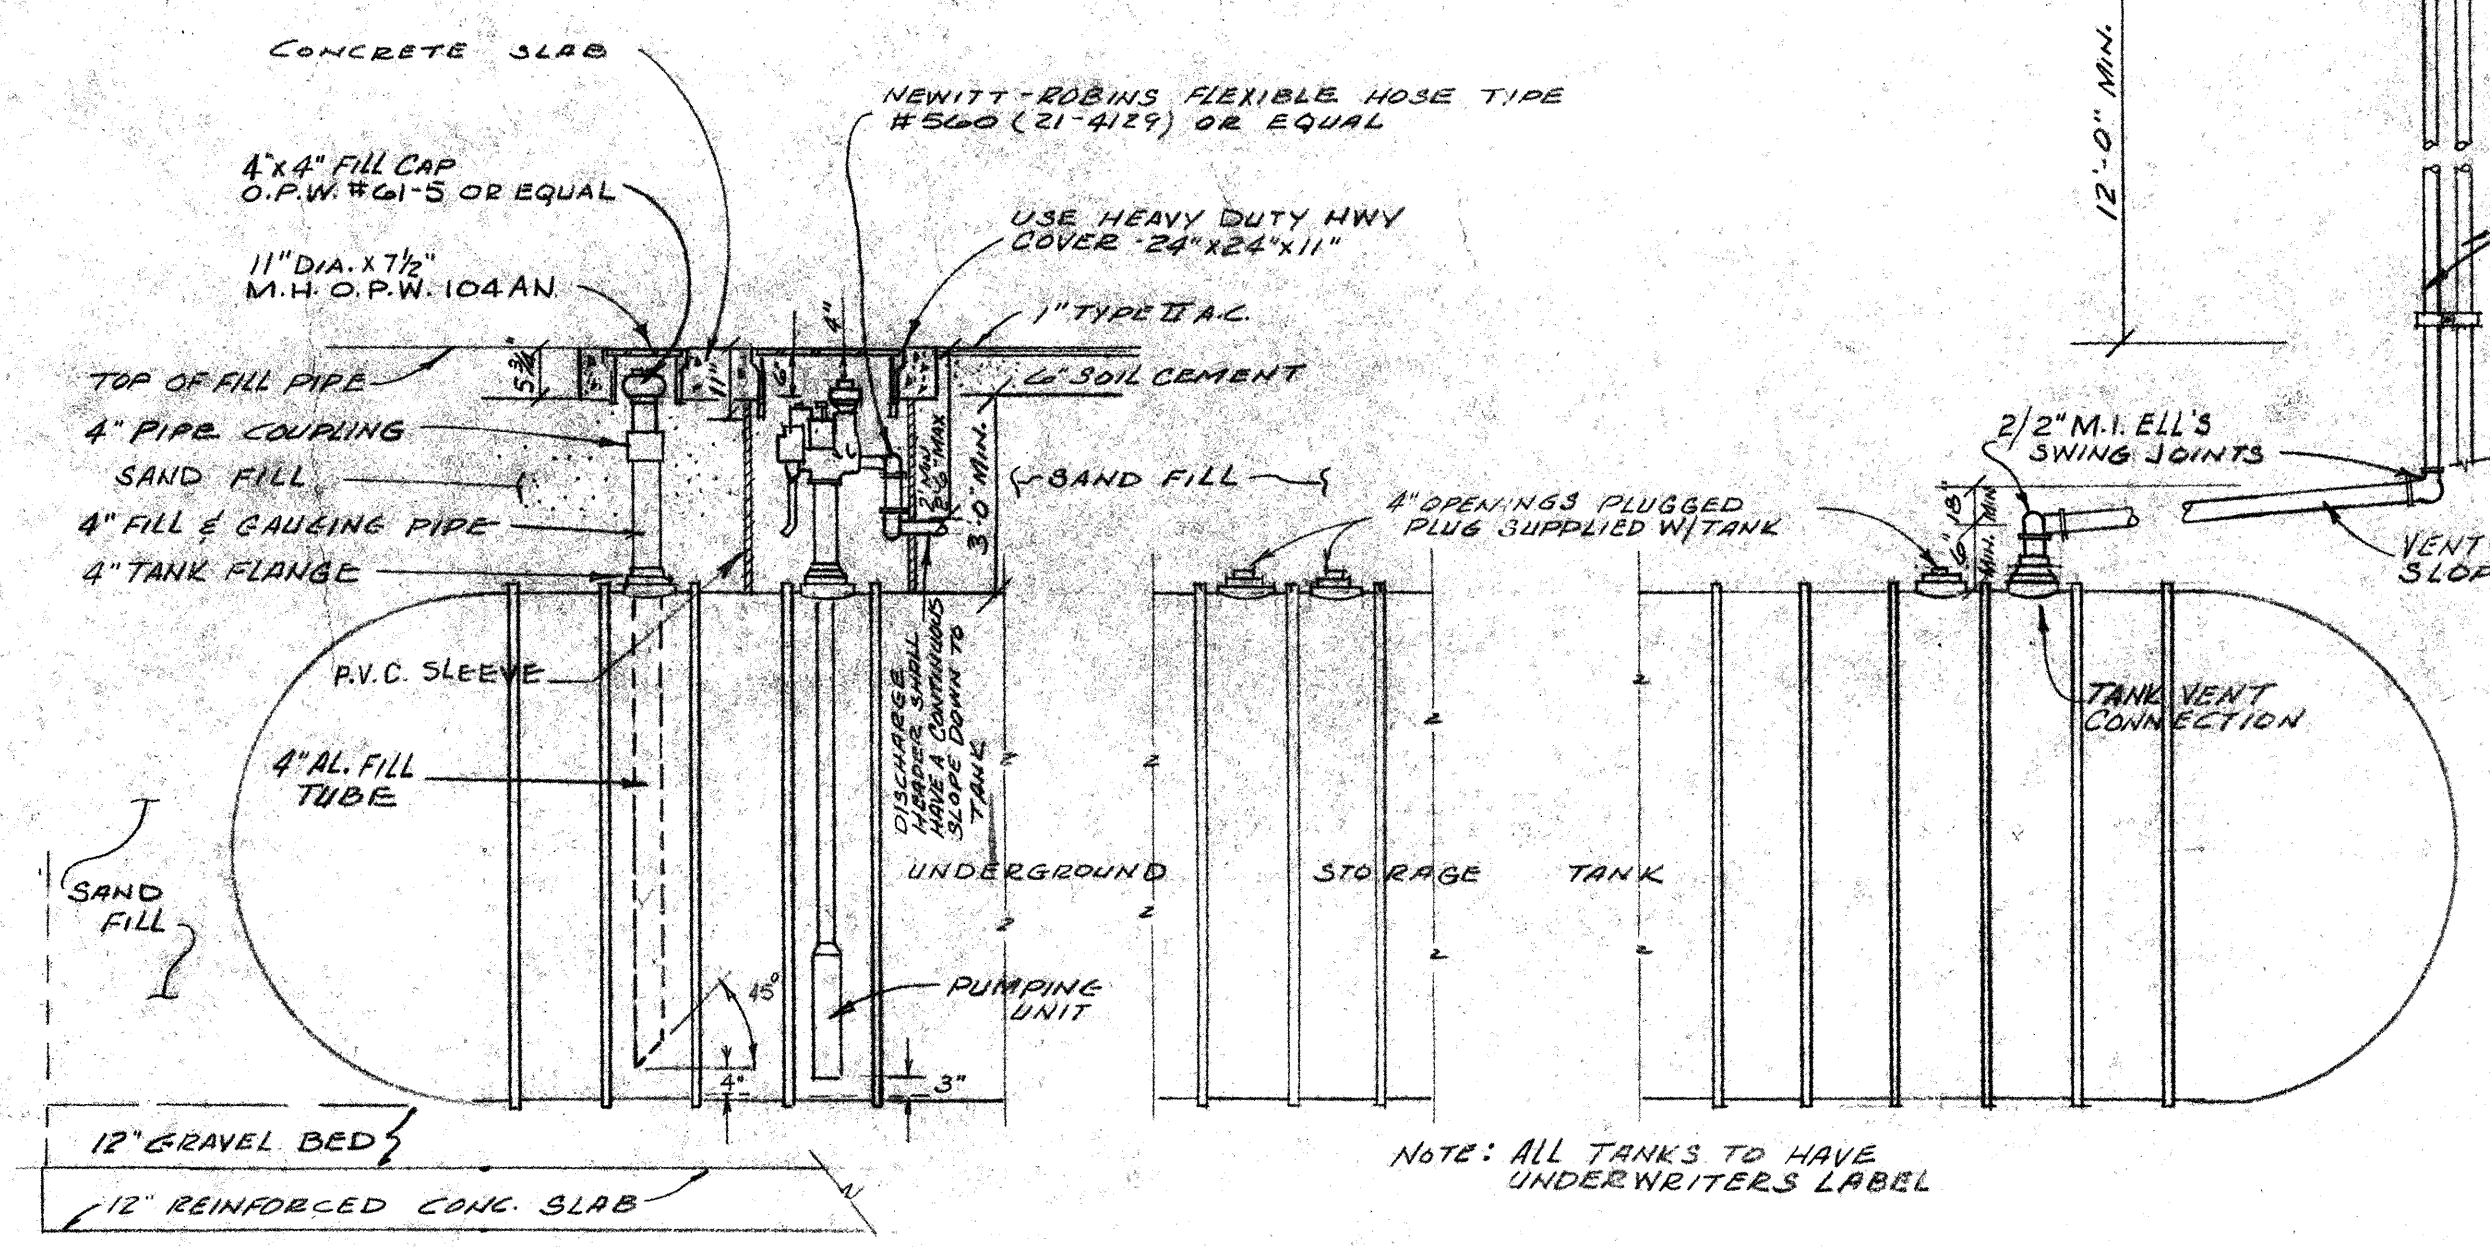


TYPICAL SECTION NO SCALE

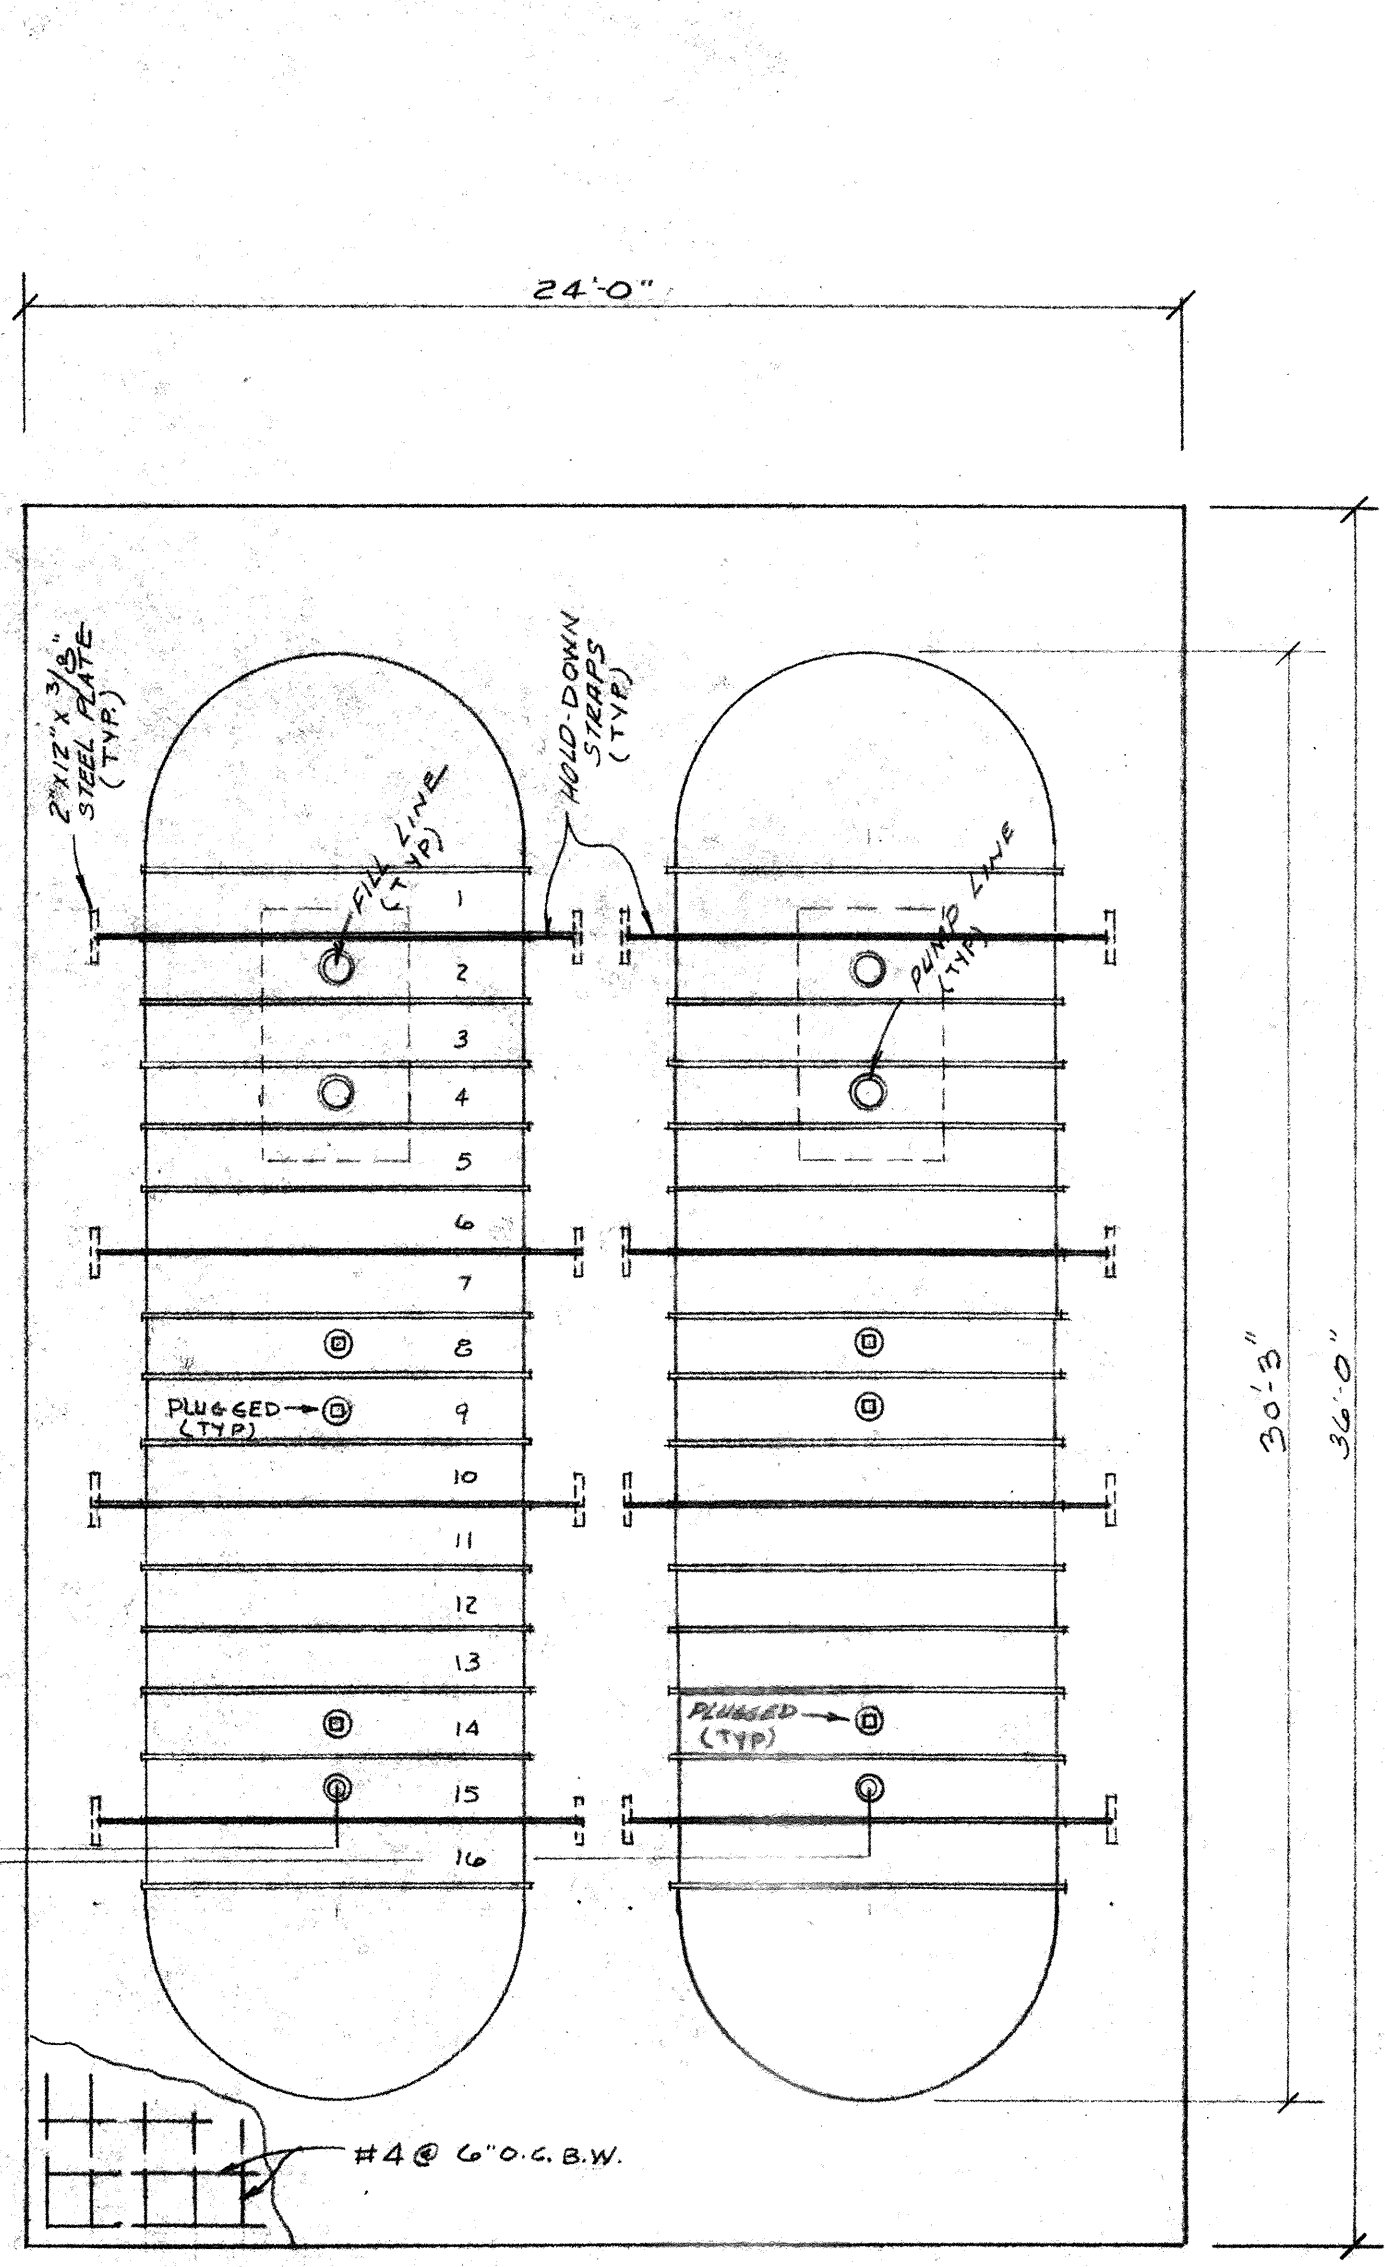


PLAN

FIBERGLAS TANKS:
 THE CONTRACTOR SHALL PROVIDE FIBERGLAS U.L.-LABELED UNDERGROUND STORAGE TANKS IN SIZES AND WITH FITTINGS AS SHOWN ON THE DRAWINGS. THE TANKS SHALL BE MANUFACTURED BY OWENS-CORNING FIBERGLAS. TANKS SHALL BE TESTED AND INSTALLED WITH PEA GRAVEL OR APPROVED ALTERNATE BACKFILL MATERIAL ACCORDING TO THE CURRENT INSTALLATION INSTRUCTIONS (O.C.F. PUBLICATION 3-PE-6904) PROVIDED WITH THE TANK.

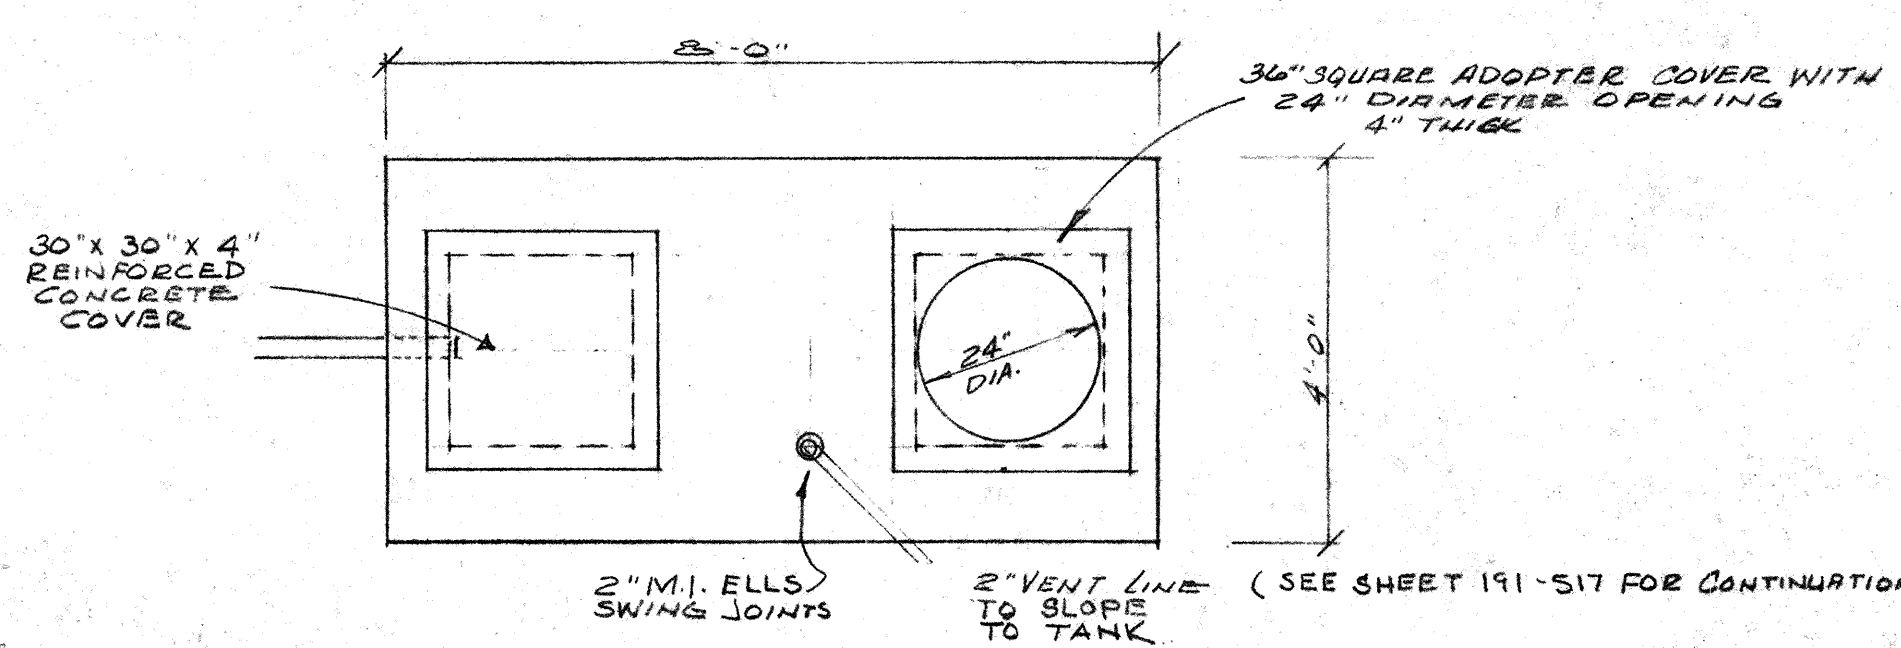


PLAN

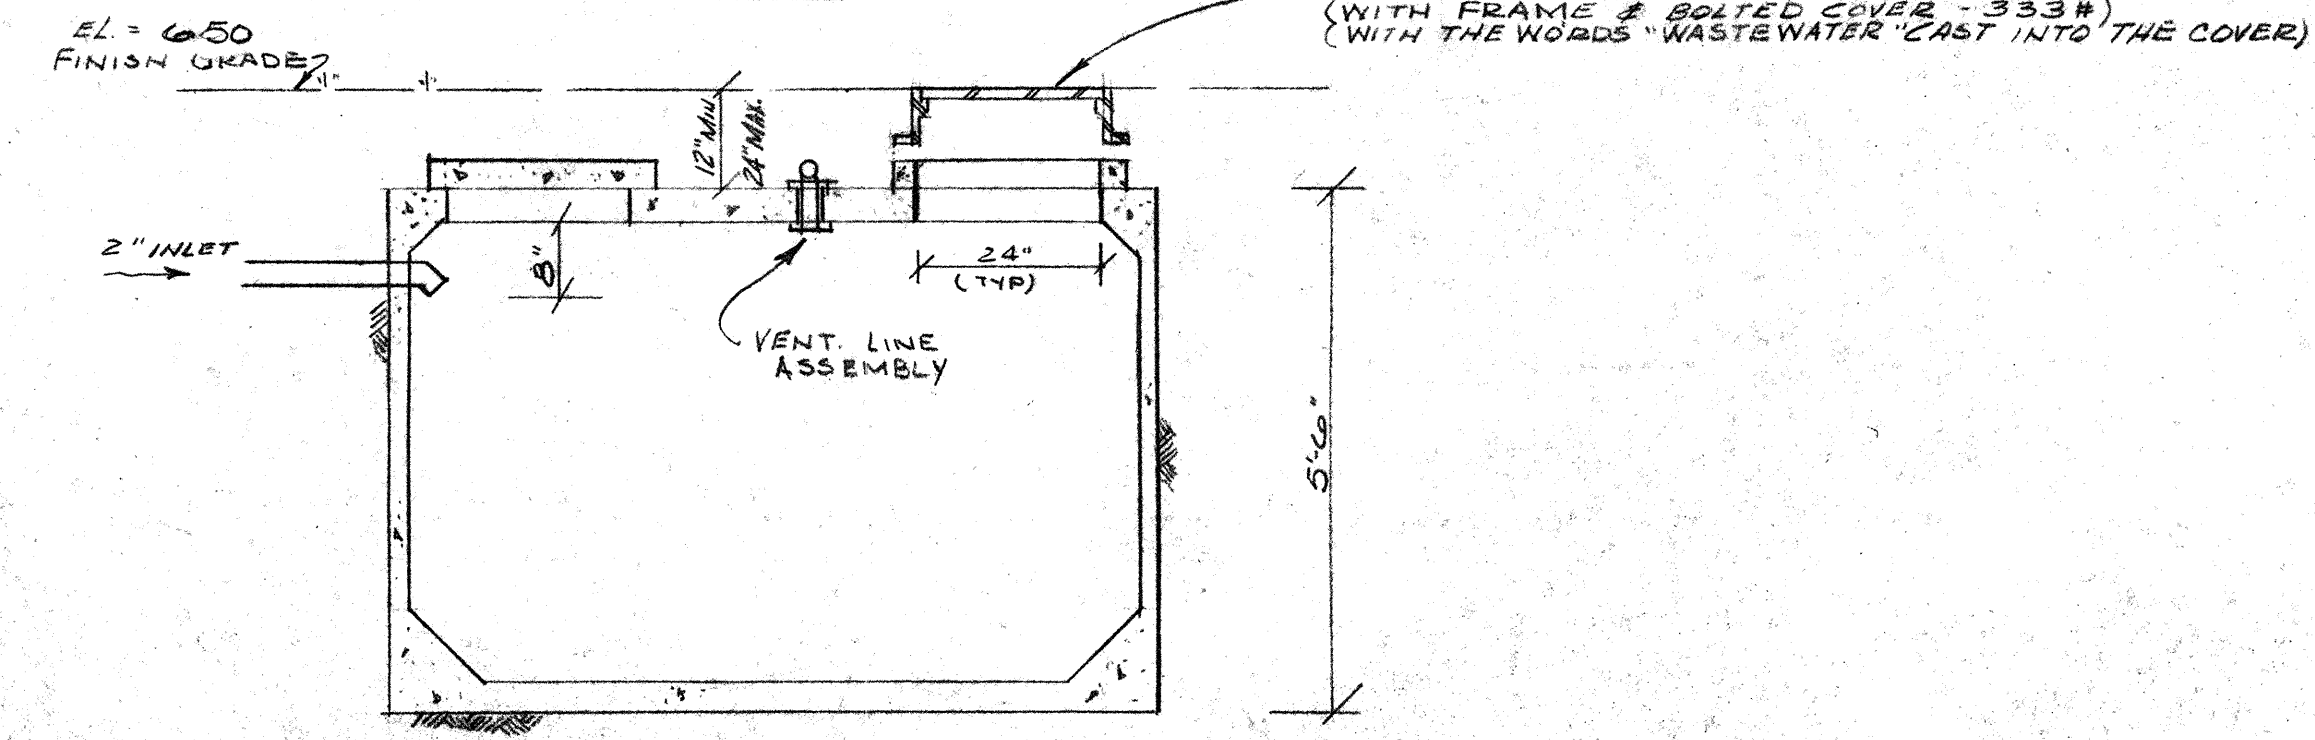


SECTION


WASTE WATER HOLDING TANK
 (750 GAL.)
 SCALE - 1/2"=1'-0"

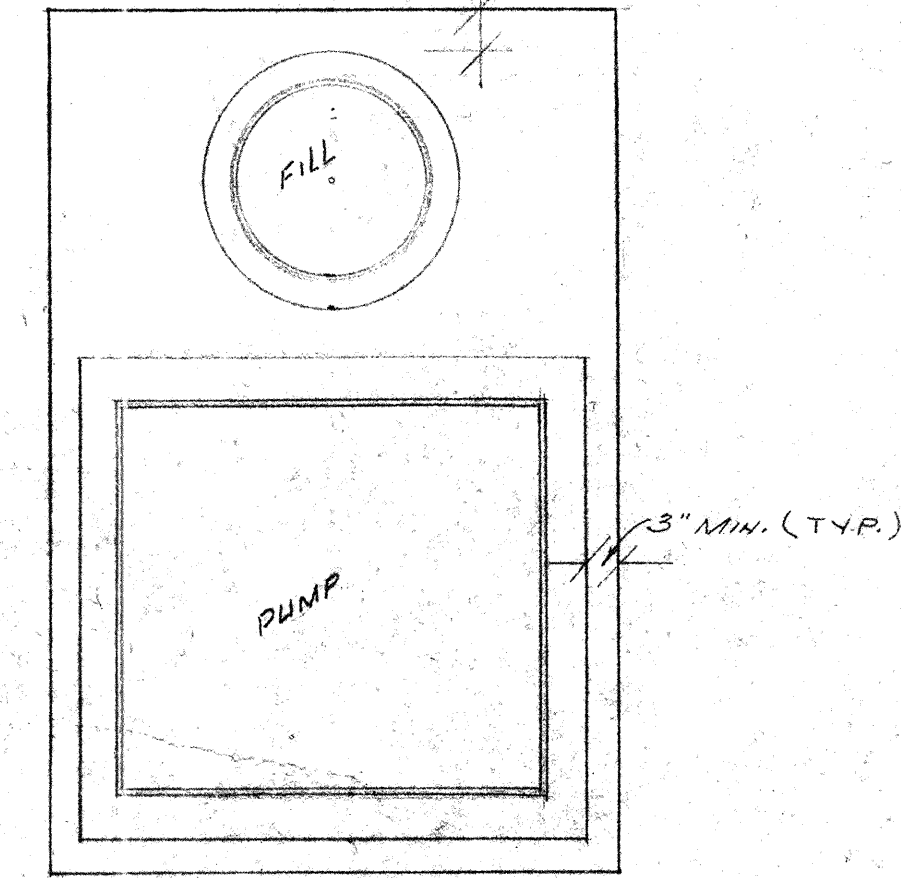

PLAN

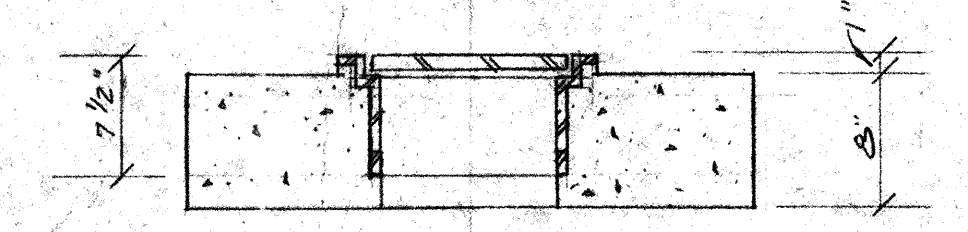


SECTION AT FILL CAP

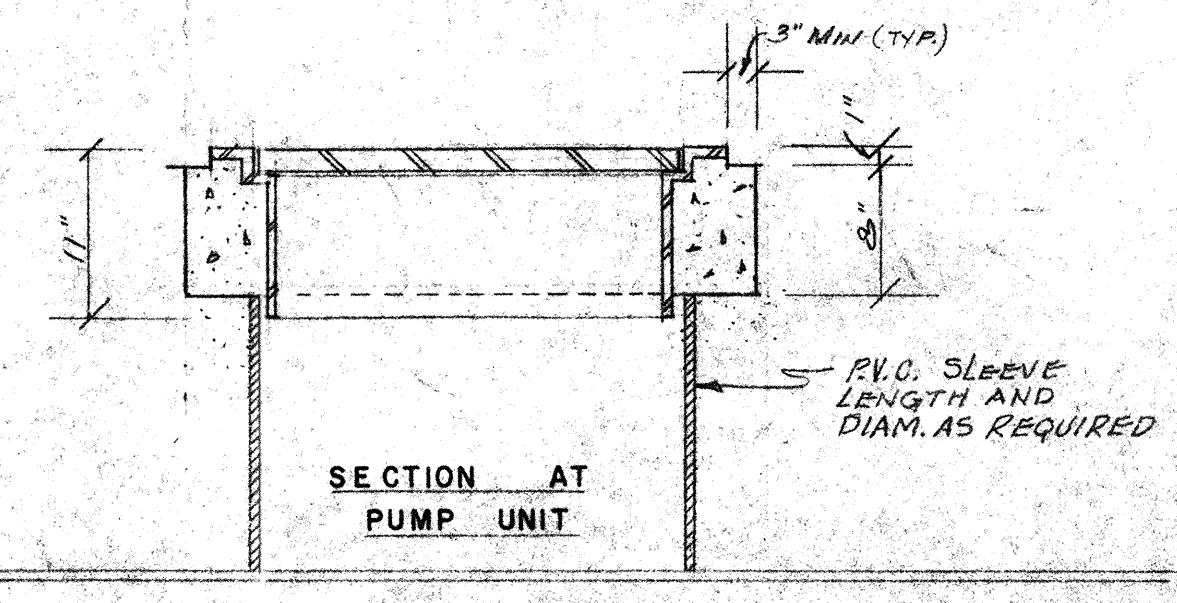

SECTION AT PUMP UNIT

CONCRETE PAD
 NO SCALE

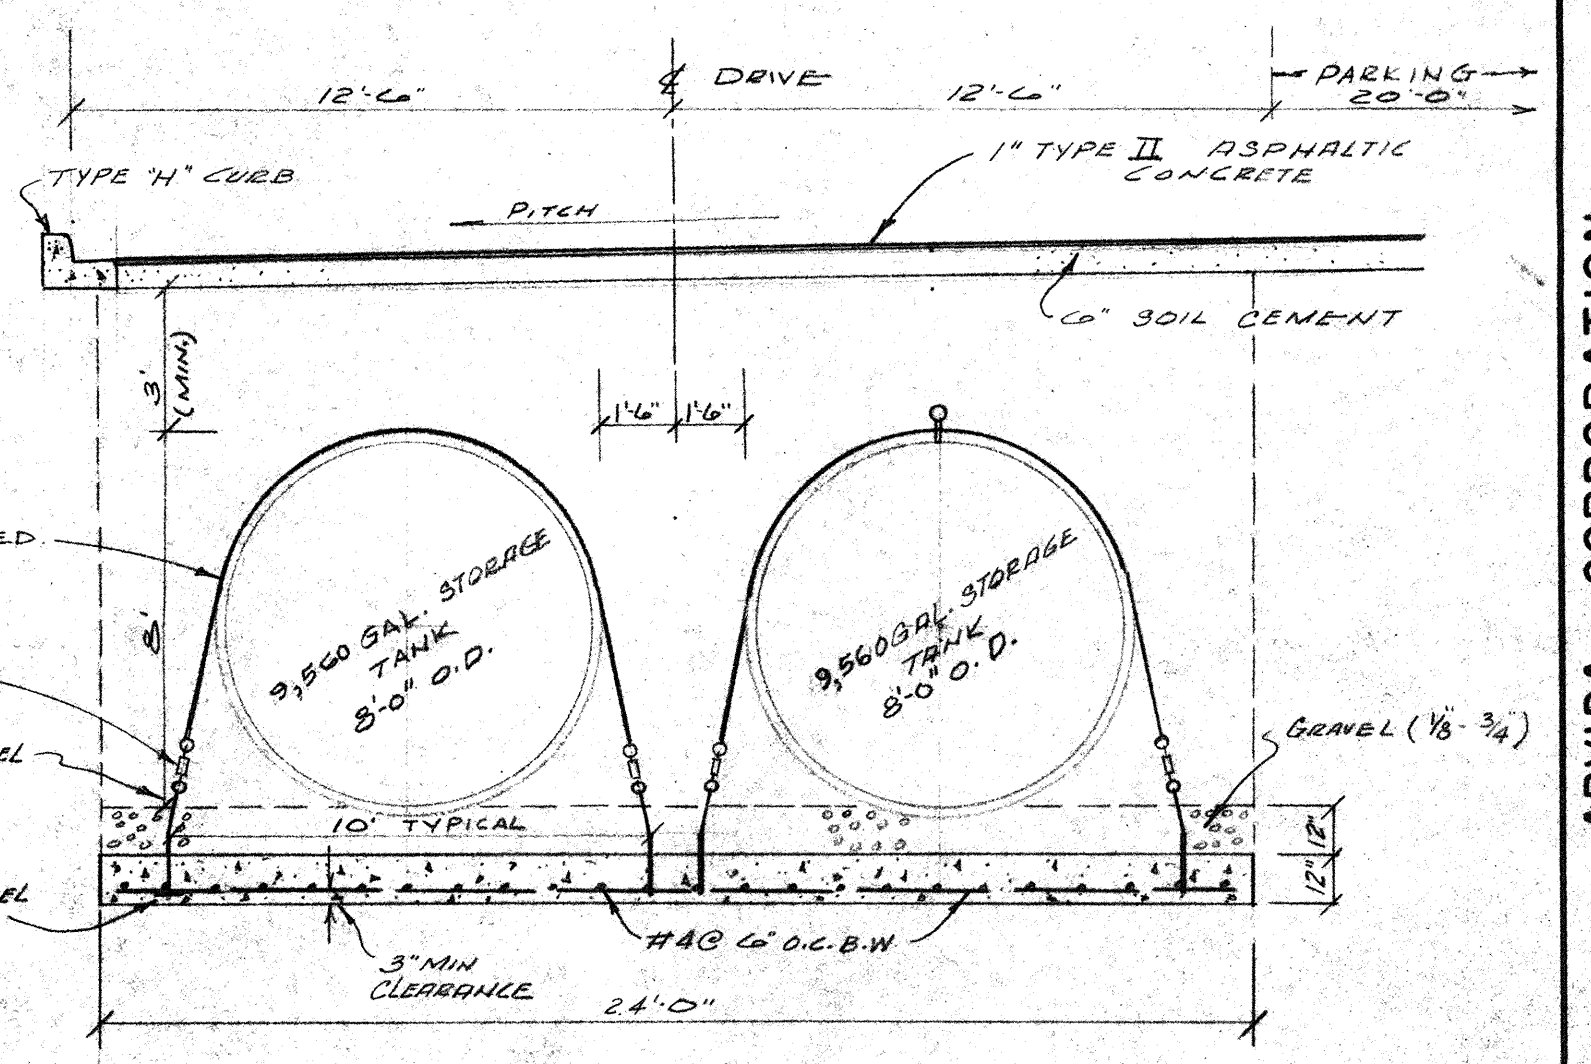

SECTION

TANK INSTALLATION DETAIL
 NO SCALE

BENNETT & BISHOP
 CONSULTING ENGINEERS & SURVEYORS
 SARASOTA, FLORIDA

ARVIDA CORPORATION
 BAY ISLES - HARBOUR MOORINGS
 SARASOTA, FLORIDA

FUEL STORAGE TANKS - MISCELLANEOUS DETAILS

DATE	SCALE	DESIGN	DRAWN	CHECK	APPROVED	DESCRIPTION
FEB. 12, 82	AS SHOWN	CB	CB	CB	CB	WASTE WATER HOLDING TANK ADD. 5'

DWG. NO. 191-528