



PIER LIGHTING DISCONNECT SWITCH SEE RISER DIAGRAM

FP&L CO. METER


25' MIN. CLEARANCE

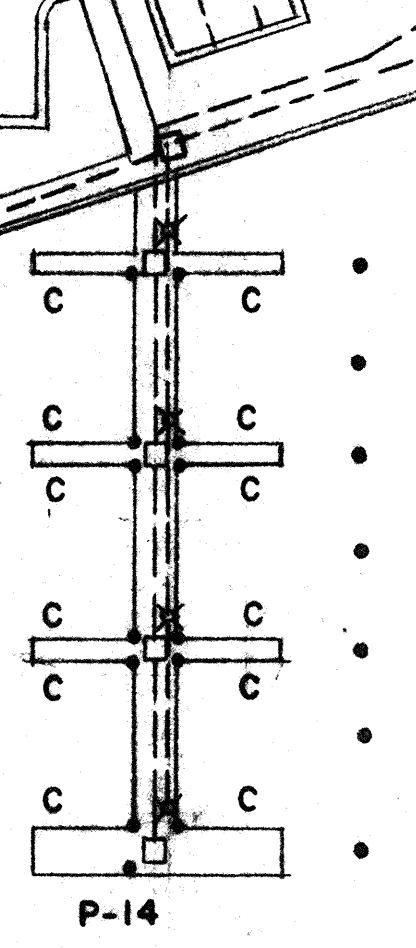


P-14

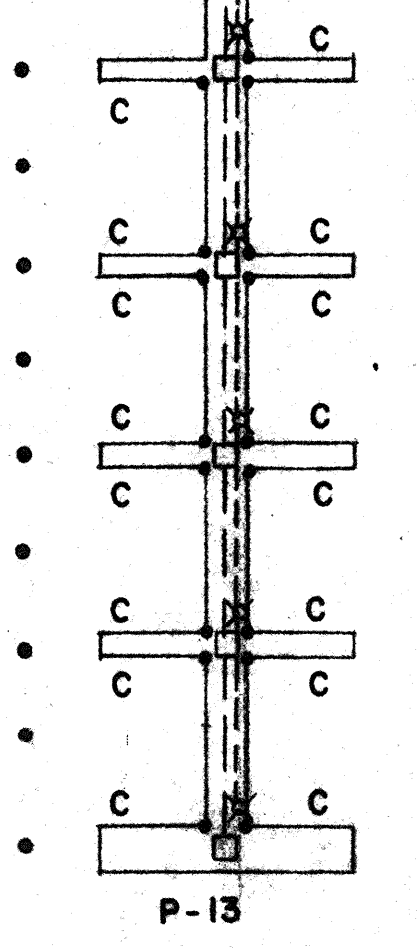


P-13

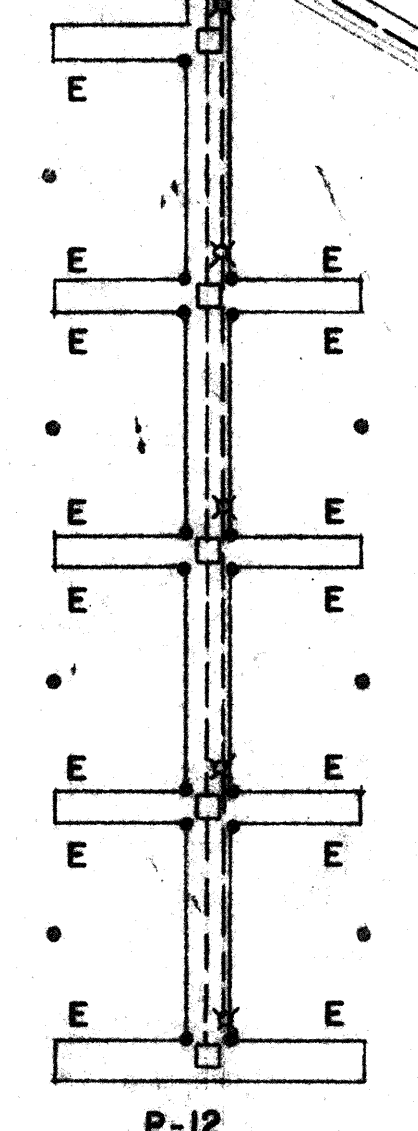


P-12

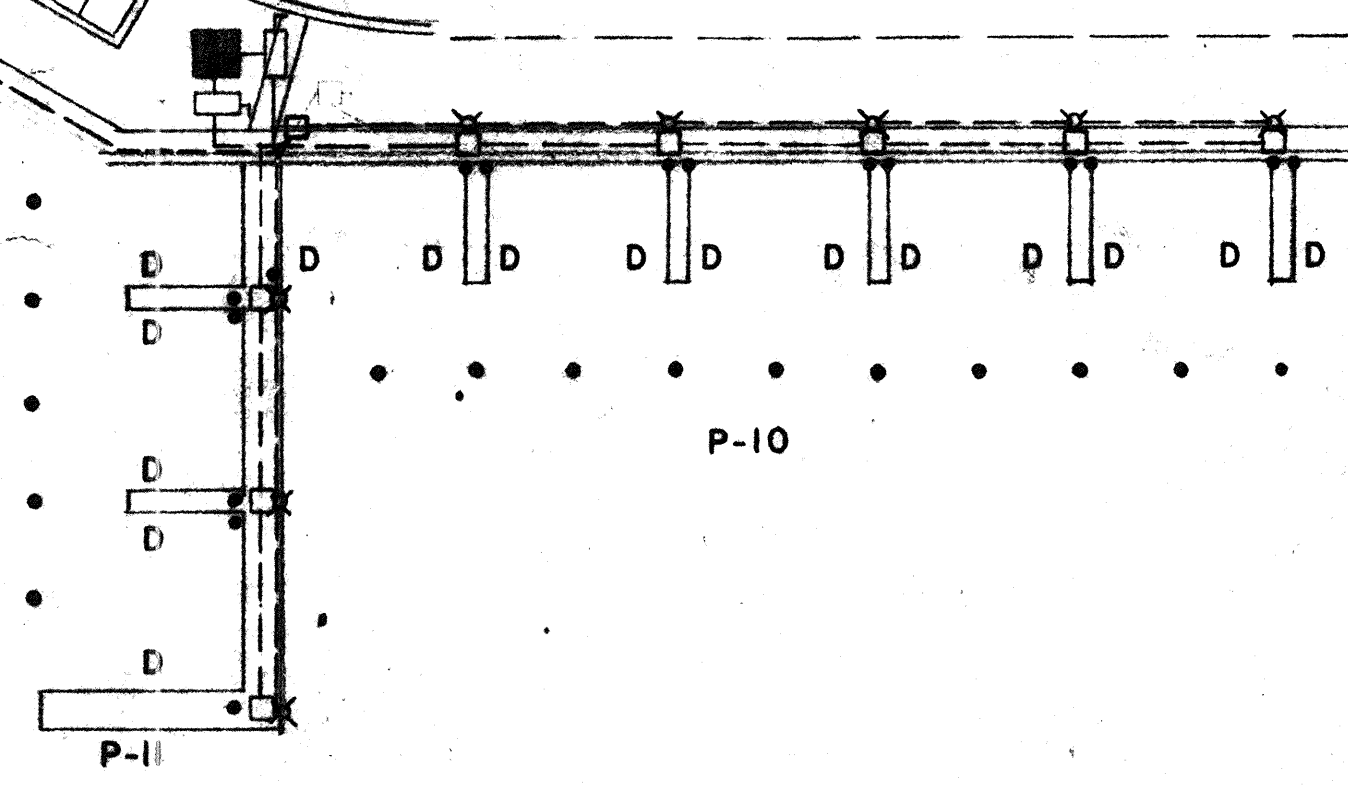


P-11

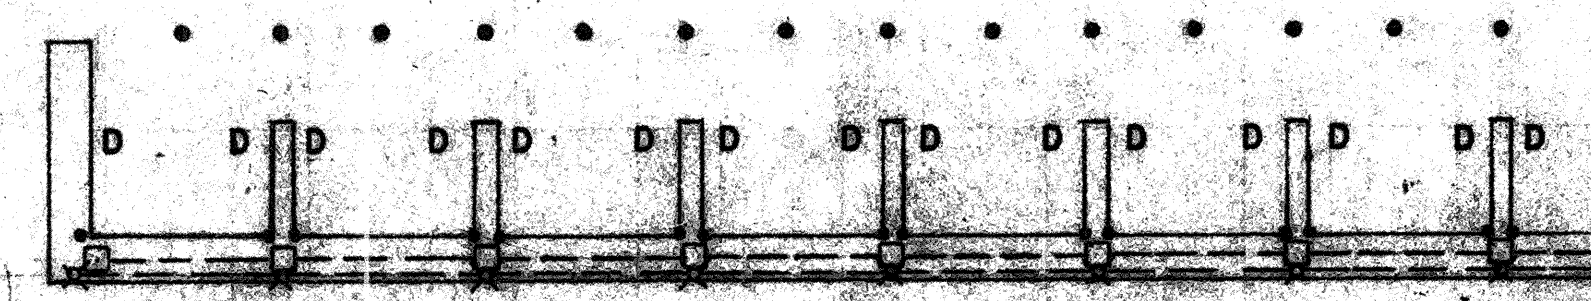


P-10

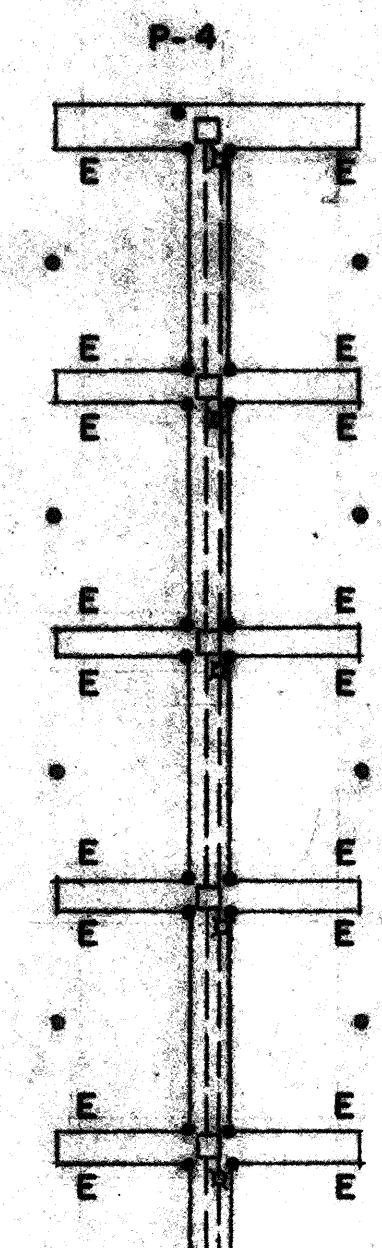


P-4

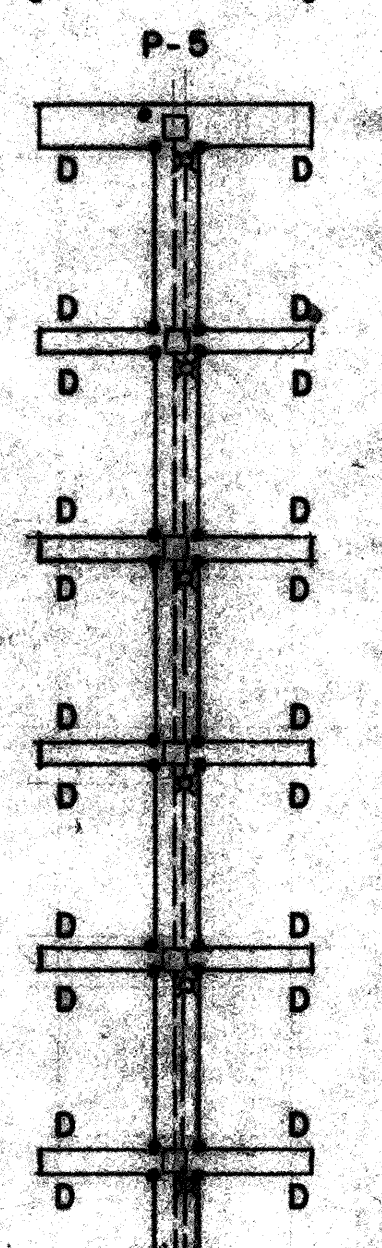

P-5

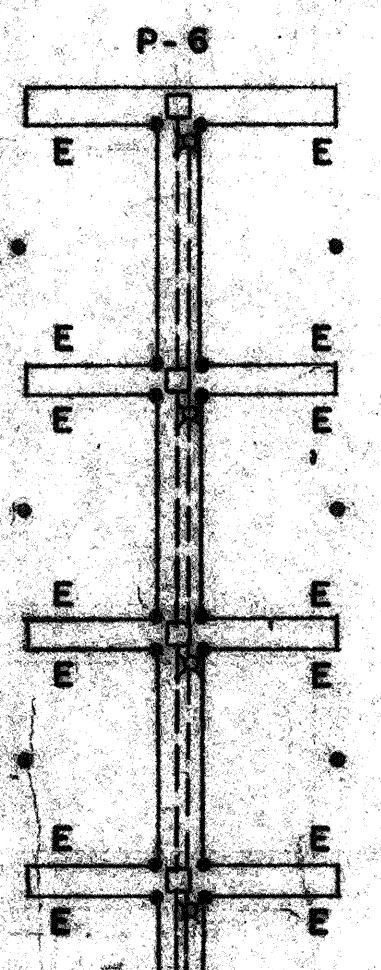

P-6

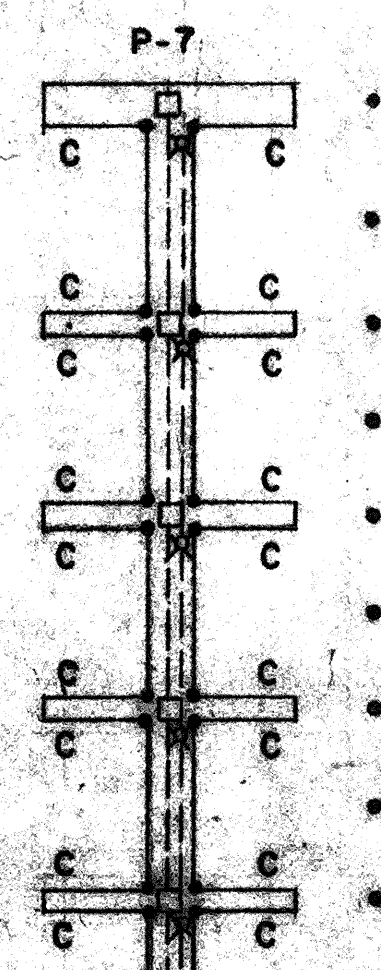

P-7

FP & L CO. METER

25' MIN. (TYP.)

25' AL. MIN. CLEARANCE BELOW OVERHEAD

FP&L SECONDARY CABLE

MAIN ELECTRICAL DISCONNECT SWITCH SYMBOL - SEE PIER SCHEDULE FOR ACTUAL QUANTITY AND SIZE. THE CONTRACTOR SHALL COORDINATE WITH THE OWNER FOR ACTUAL PLACEMENT AND MOUNTING DETAILS (TYPICAL).

EXISTING FP&L TRANSFORMER

FLORIDA POWER & LIGHT COMPANY PAD-MOUNTED TRANSFORMER 120/240 VOLT, 3-PHASE, 3-WIRE SECONDARY. ACTUAL LOCATION OF TRANSFORMERS TO BE SELECTED BY OWNER AND UTILITY COMPANY. (TYPICAL)

MATCH LINE

8/1/12 Bay Isles Marina