LEGEND

- 8" V.C. PIPE & M.H., UNLESS NOTED
- (+5) APPROX. GRADE
- -1.2 PIPE INVERT

LIFT STATION DATA

STATION	UNITS	FLOW (GPM)	
		AVERAGE	DESIGN
L.S. "4F"	489	76	306
"5F"	500+COM.	97	388
"6F"	126+CLUB	46	184
"7F"	1,760	275	688
"8F"	333	52	208

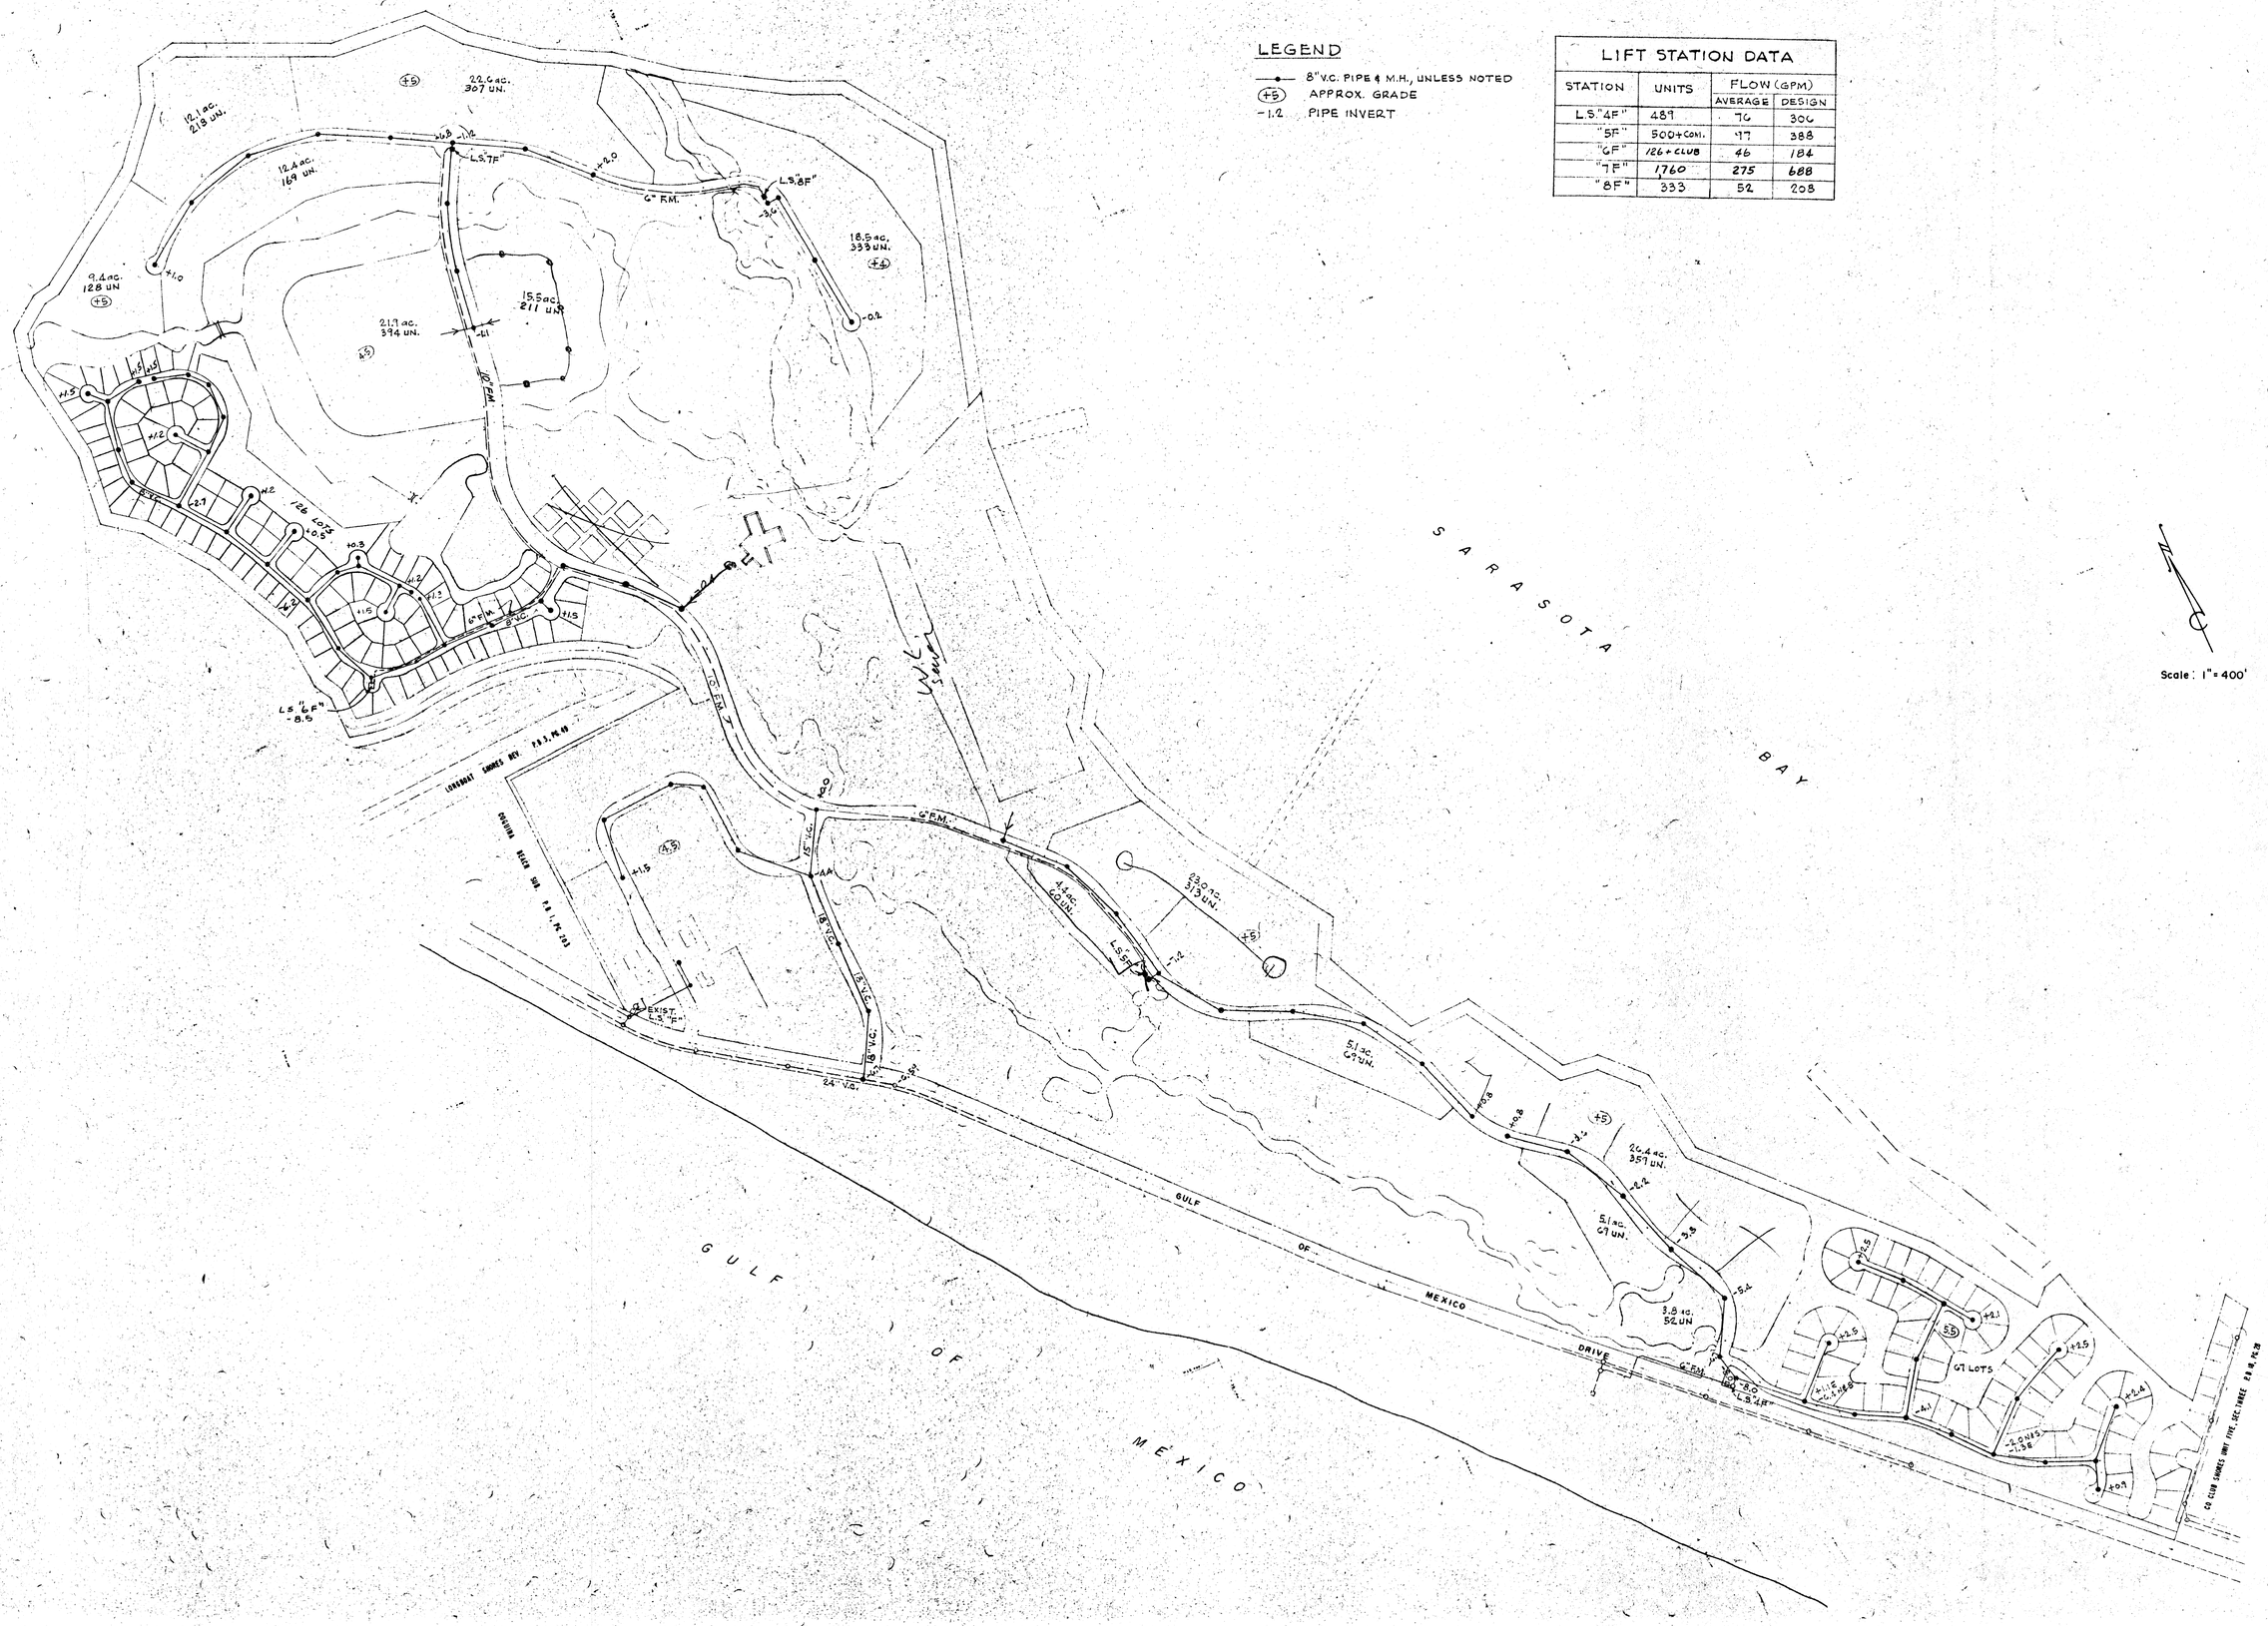

Scale: 1" = 400'

ARVIDA CORPORATION
BAY ISLES
SANITARY SEWERAGE MASTER

BENNETT & BISHOP
CONSULTING ENGINEERS & SURVEYORS
SARASOTA FLORIDA
PHONE 388-2178

REVISED	DATE	BY
	12/17/75	SHOW GULF & SANITARY SEWERS & MISC. CHG.	C.H.
	12/11/75	ADDED MISC. CHANGES (L.S.) & MISC.	E.B.
	12/1/75	ADDED 8" V.C. PIPE IN COMM. AREA	G.L.B.

DATE	8/5/75
SCALE	1" = 400'
DESIGN	G.L.B.
DRAWN	G.L.B.
CHECK	
APPROVED	

DWRG. NO.
191-074