



LONGBOAT PASS



Sta. 12+09.0

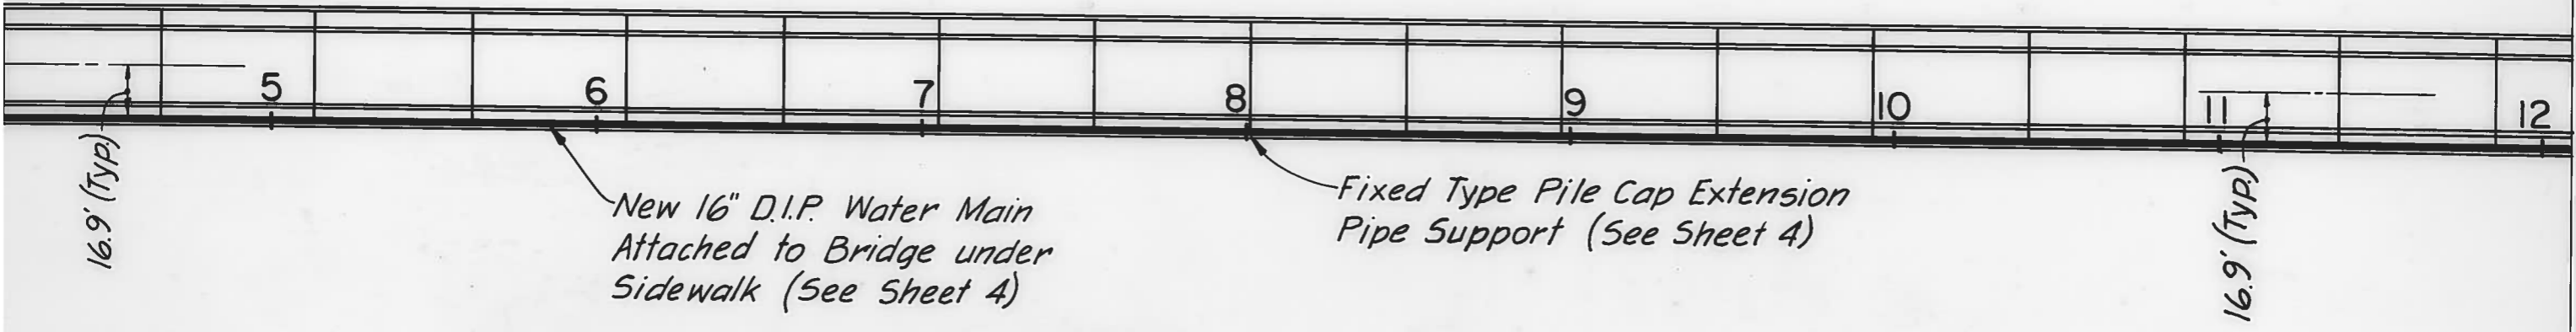

**NOTES:**

1. Bench mark (MCBE-22) located 43.2' north of south end of bridge, in sidewalk, 13.8' west of center line of bridge. Elevation = 15.23 MSL.
2. All pipe, valves, fittings and appurtenances buried on shore shall be encased in polyethylene in accordance with the Specifications.
3. Prior to submitting shop drawings and ordering materials for connection to existing water main on shore and pipe supports and hangers on the bridge, Contractor shall conduct "Preliminary Investigations" as specified in the Specific Provisions.
4. Contractor shall take all precautions necessary to protect existing water main, electric cable and bridge from any damage.

**PLAN**

"R Flex" Restrained Joint D.I.P.

